


Water Conditions Report

**Board of Directors Meeting
September 15, 2025**




Northern Sierra Precipitation: 8-Station Index, September 11, 2025

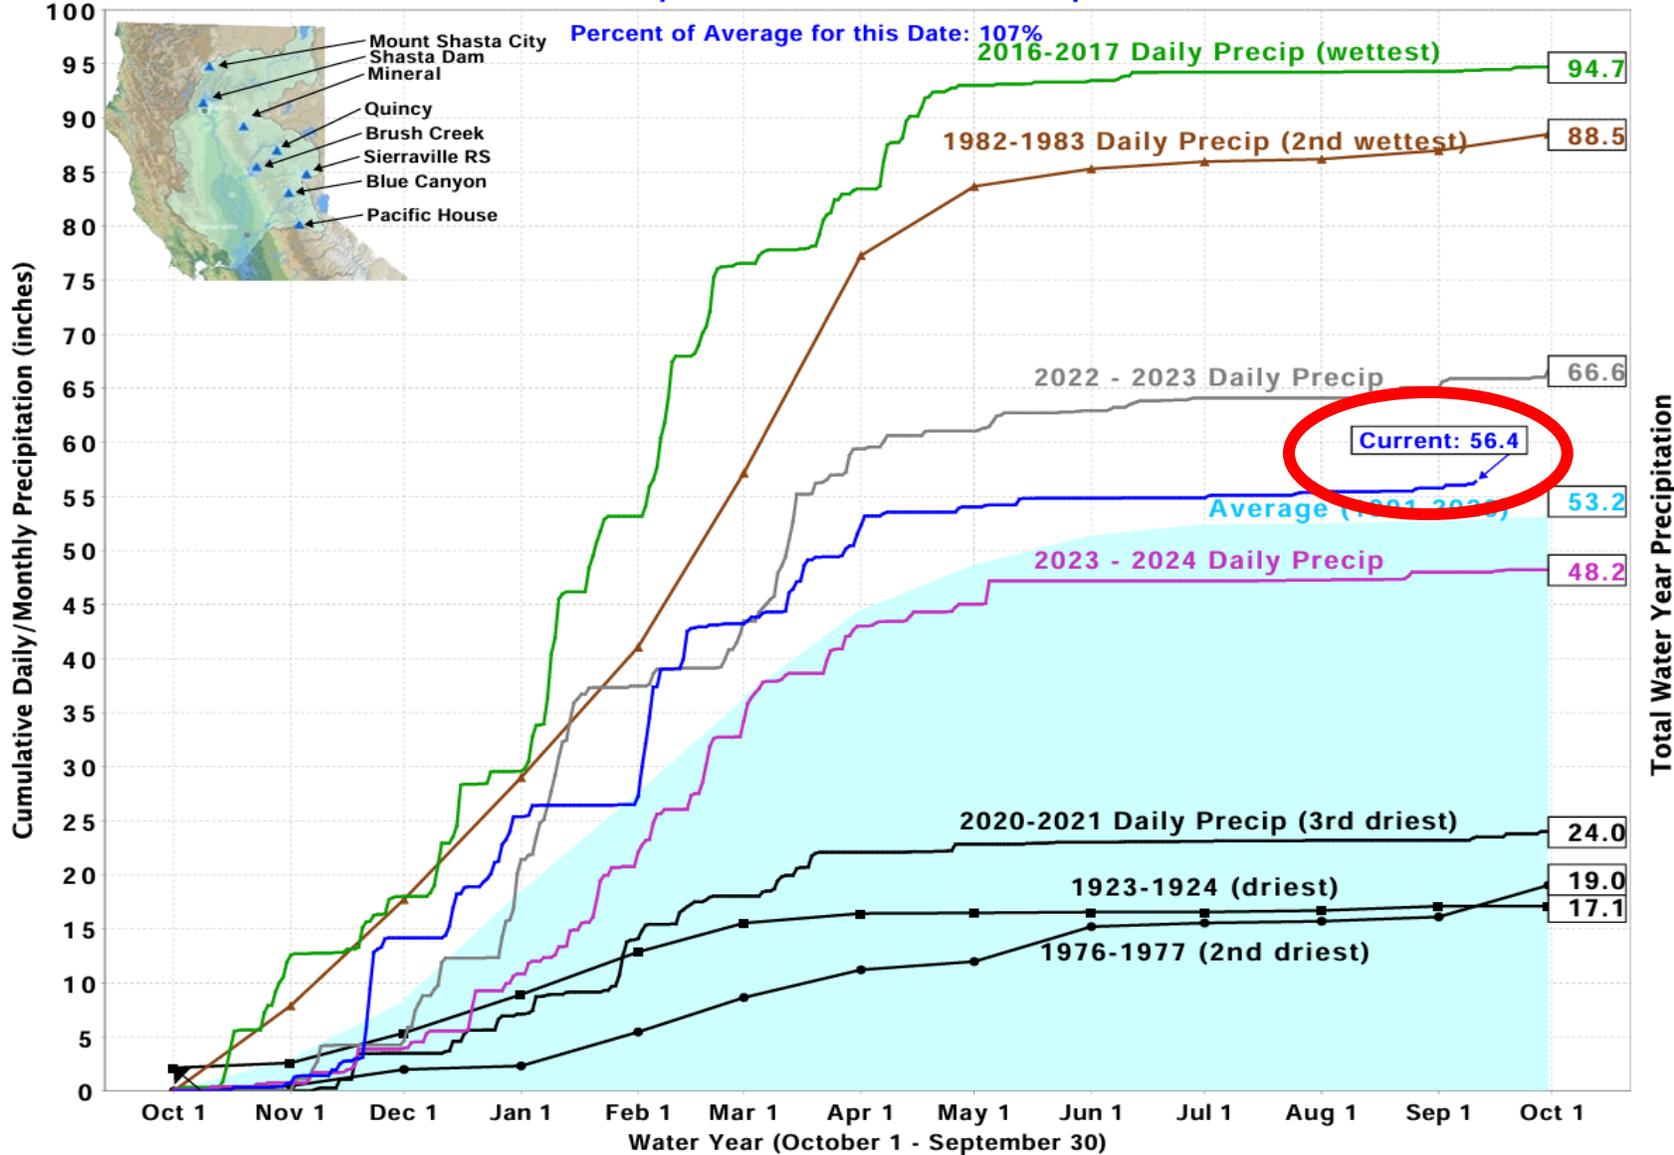


Precipitation Stations – North Sierra

CURRENT CONDITIONS: MAJOR WATER SUPPLY RESERVOIRS: 10-SEP-2025

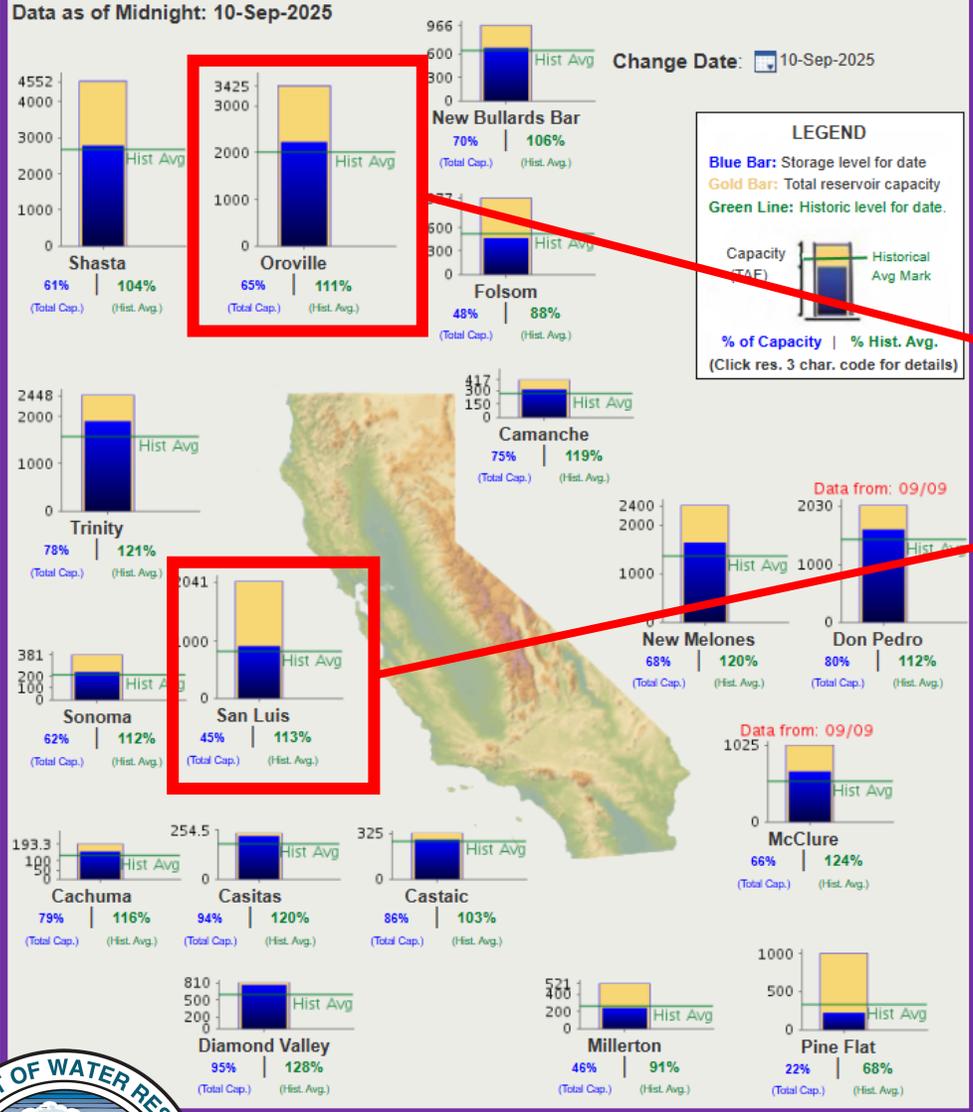

San Luis Res Levels: Various Past Water Years and Current Water Year, Ending At Midnight September 10, 2025

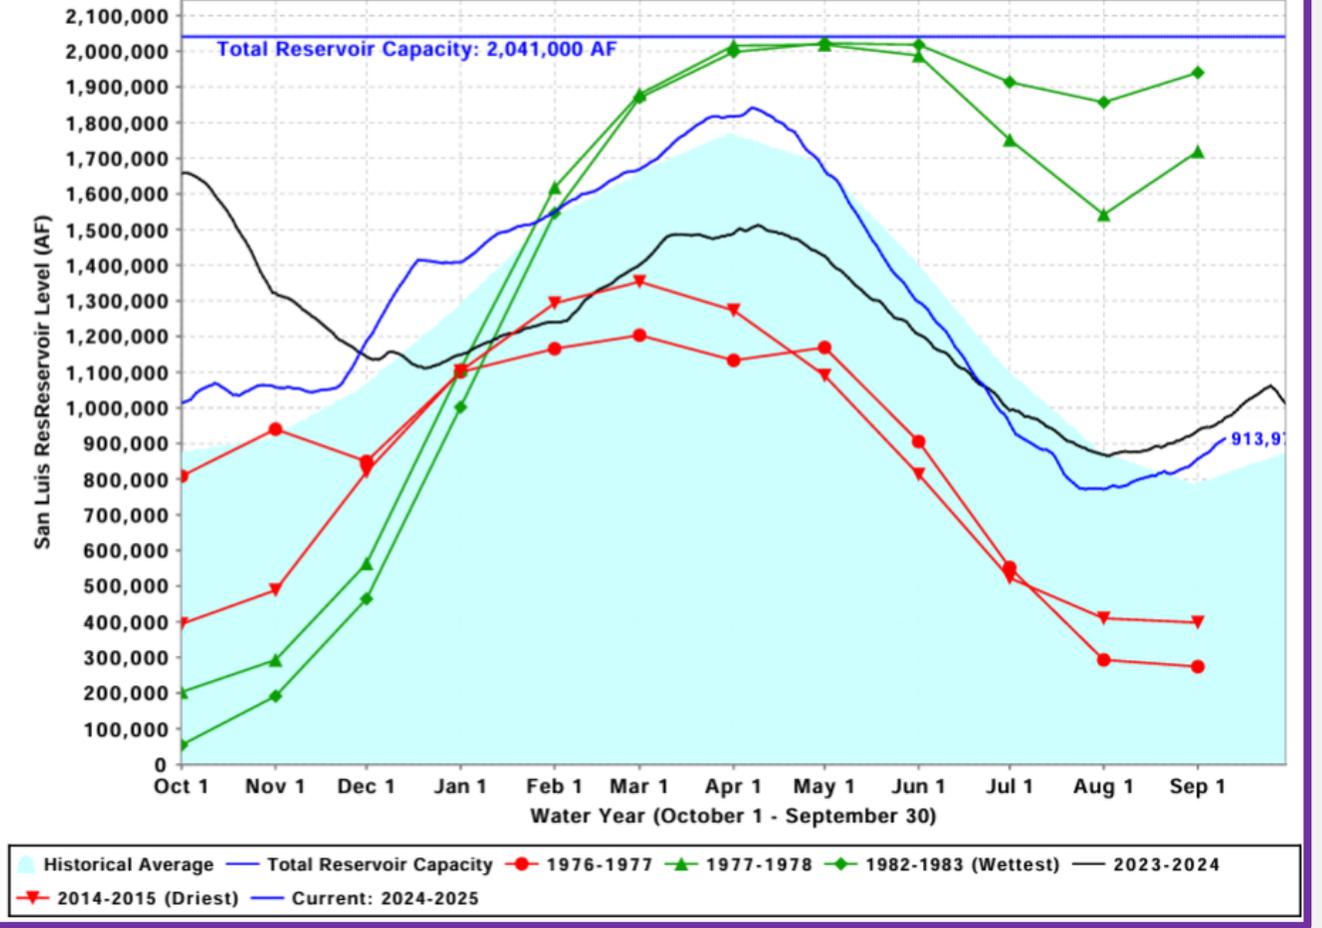

Current Reservoir Conditions




SWP Allocation Timeline


- December 2, 2024: 5% Allocation
- December 23, 2024: 15% Allocation
- January 28, 2025: 20% Allocation
- February 25, 2025: 35% Allocation
- March 25, 2025: 40% Allocation
- April 29, 2025: 50% Allocation

SGPWA Portfolio @ 50%		
Source	Total (AF)	Delivered
SWP – Carryover	1,217	✓
SWP – Table A	8,650	✓
SWP – Ventura	5,000	✓
Non-SWP - Nickel Water	1,700	✓
City of Yuba City Purchase	3,000	✓
Total Available Supply	19,567	

Historic SWP Allocations

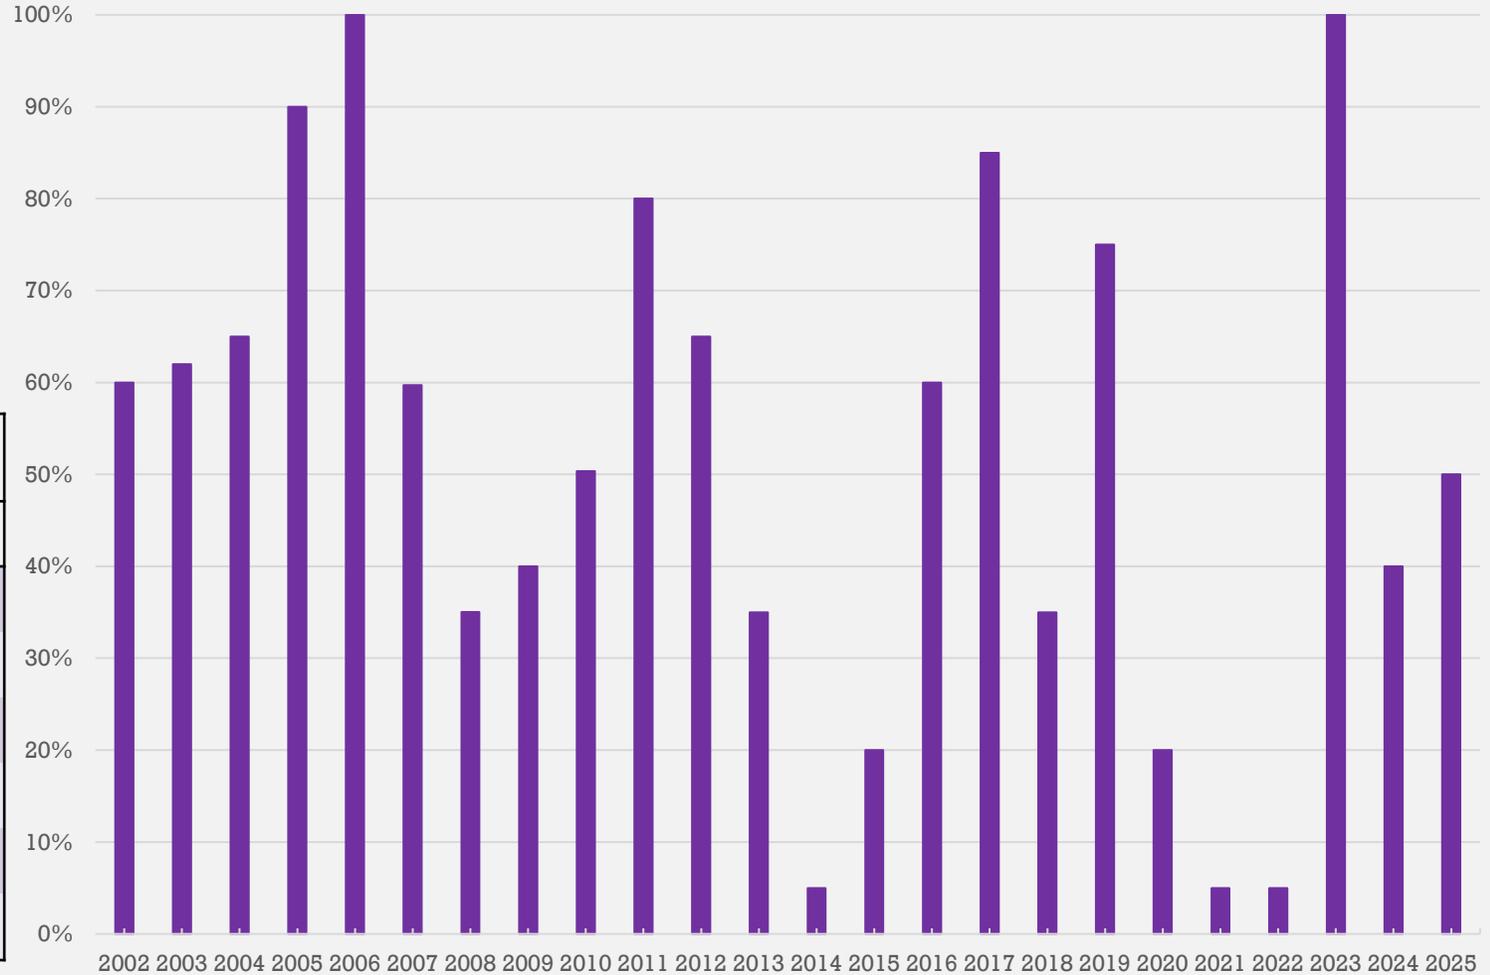

2025 SWP Allocation & Portfolio Update

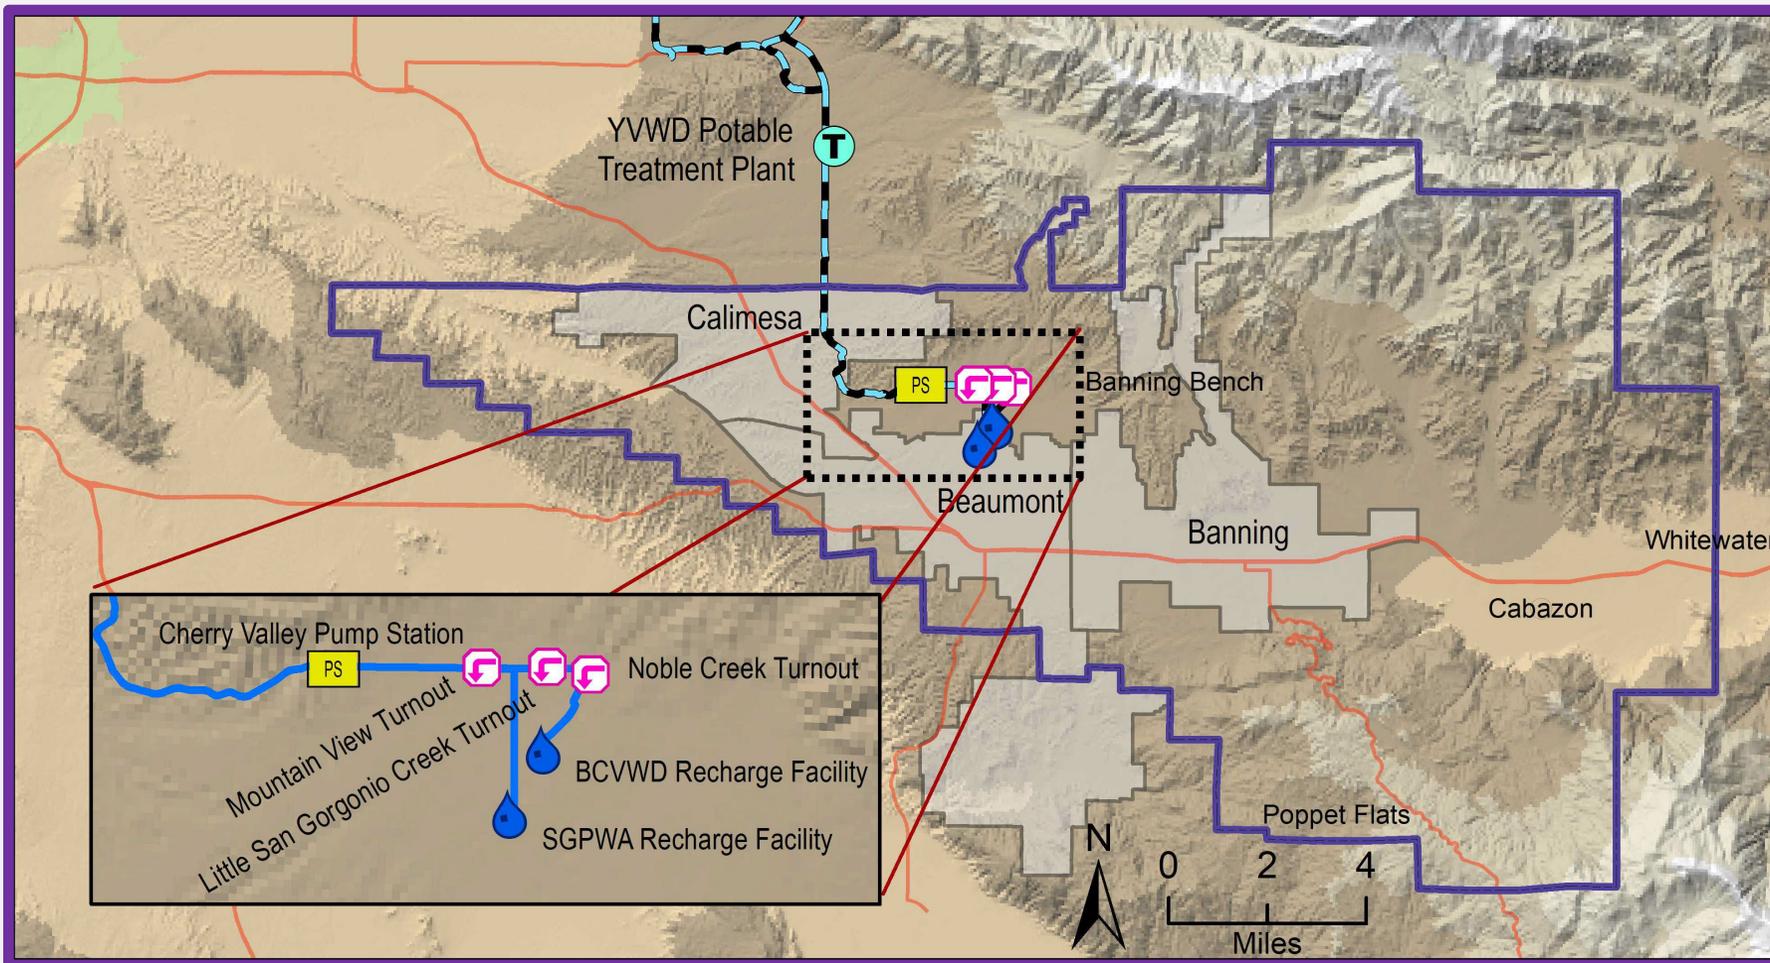

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sept	Oct	Nov	Dec	Total
Recharge	53	1,034	2,306	1,973	1,515	2,052	1,789	2,132	2,100				14,954
Direct	0	0	13	0	0	0	0	0	0				13

**Estimated*
**From Local Storage*




Local Deliveries 2025 (acre-feet)

Subject to Final Verification




2023-25 SGPWA SWP Deliveries

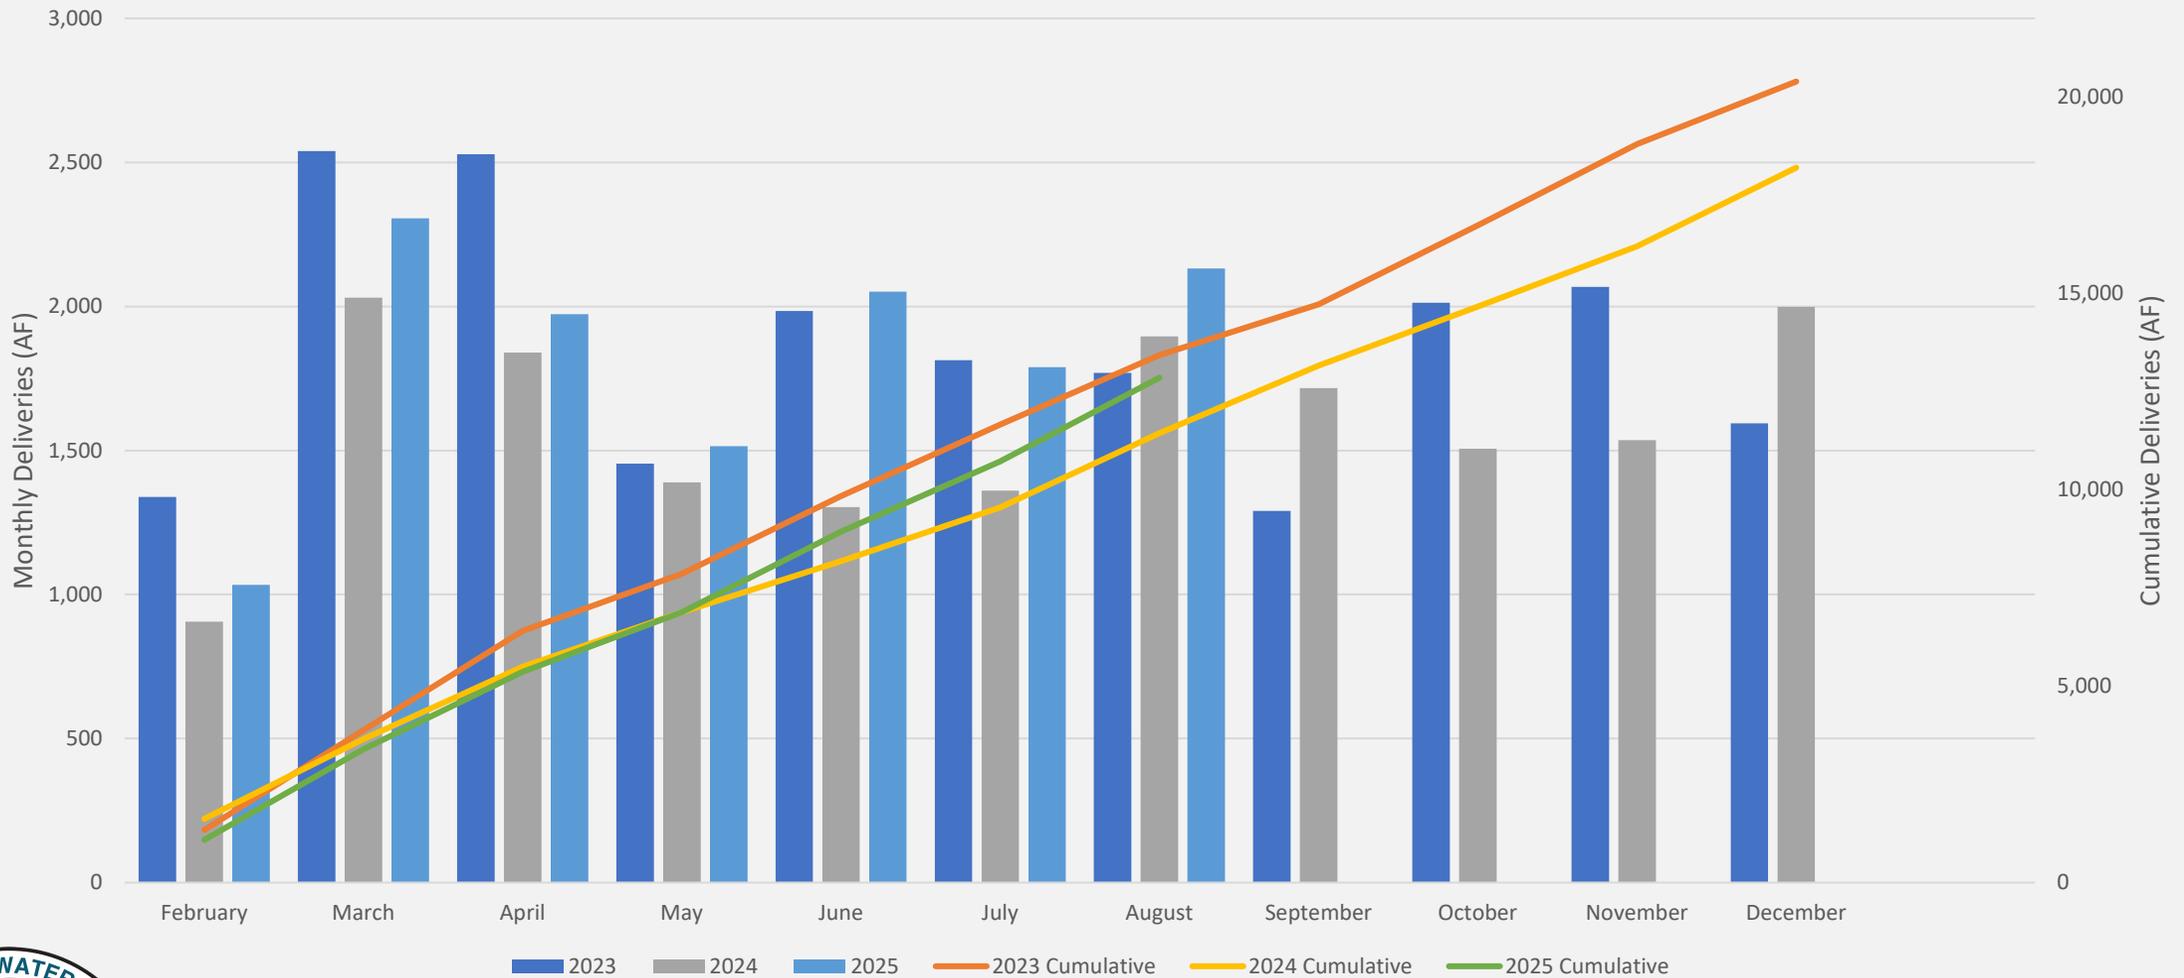

Annual Comparison of SWP Deliveries



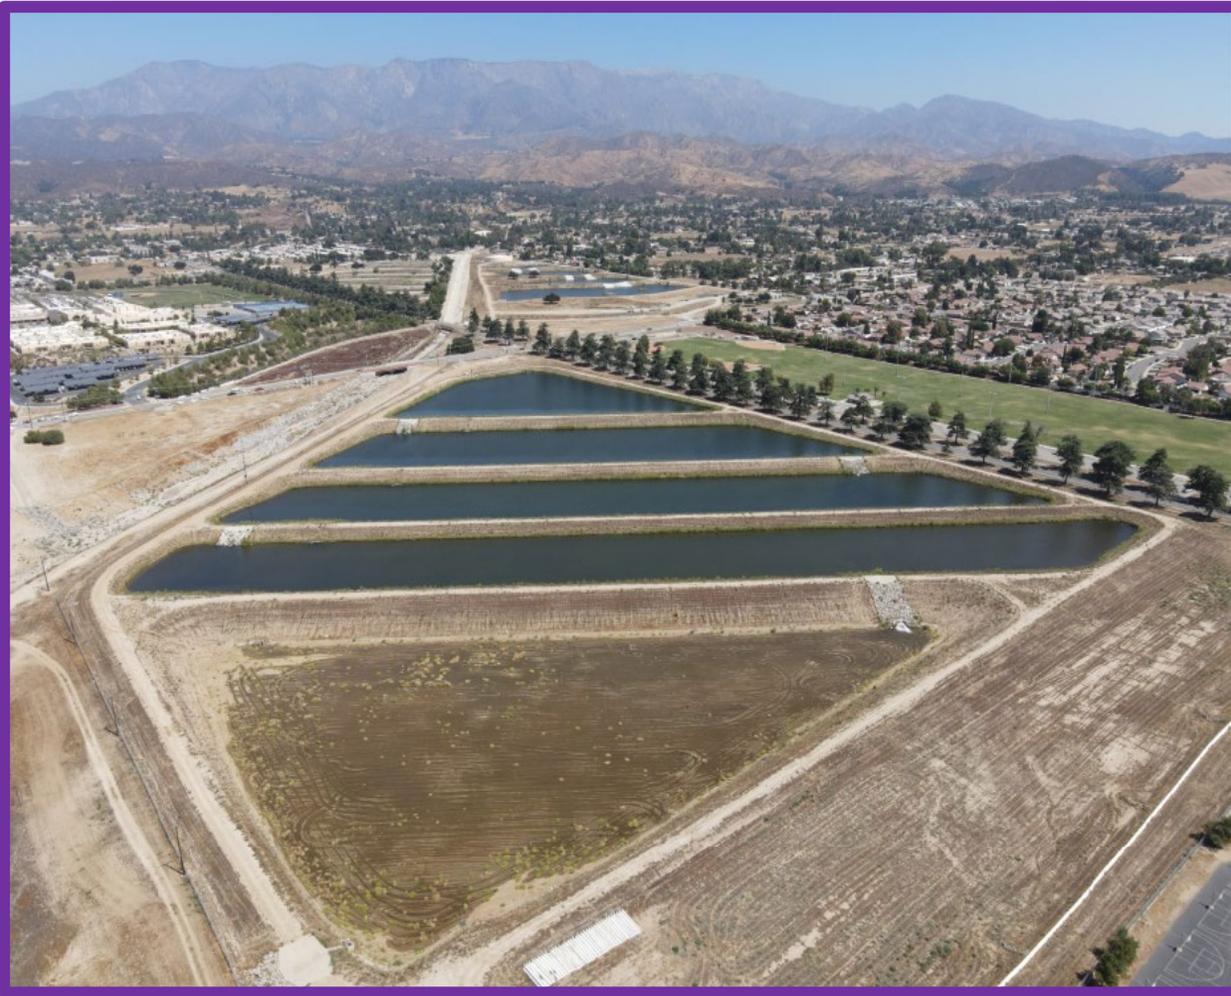

Brookside East Recharge Facility



BCVWD Recharge Facilities



September Recharge Photos

