


Water Conditions Report

**Board of Directors Meeting
October 20, 2025**



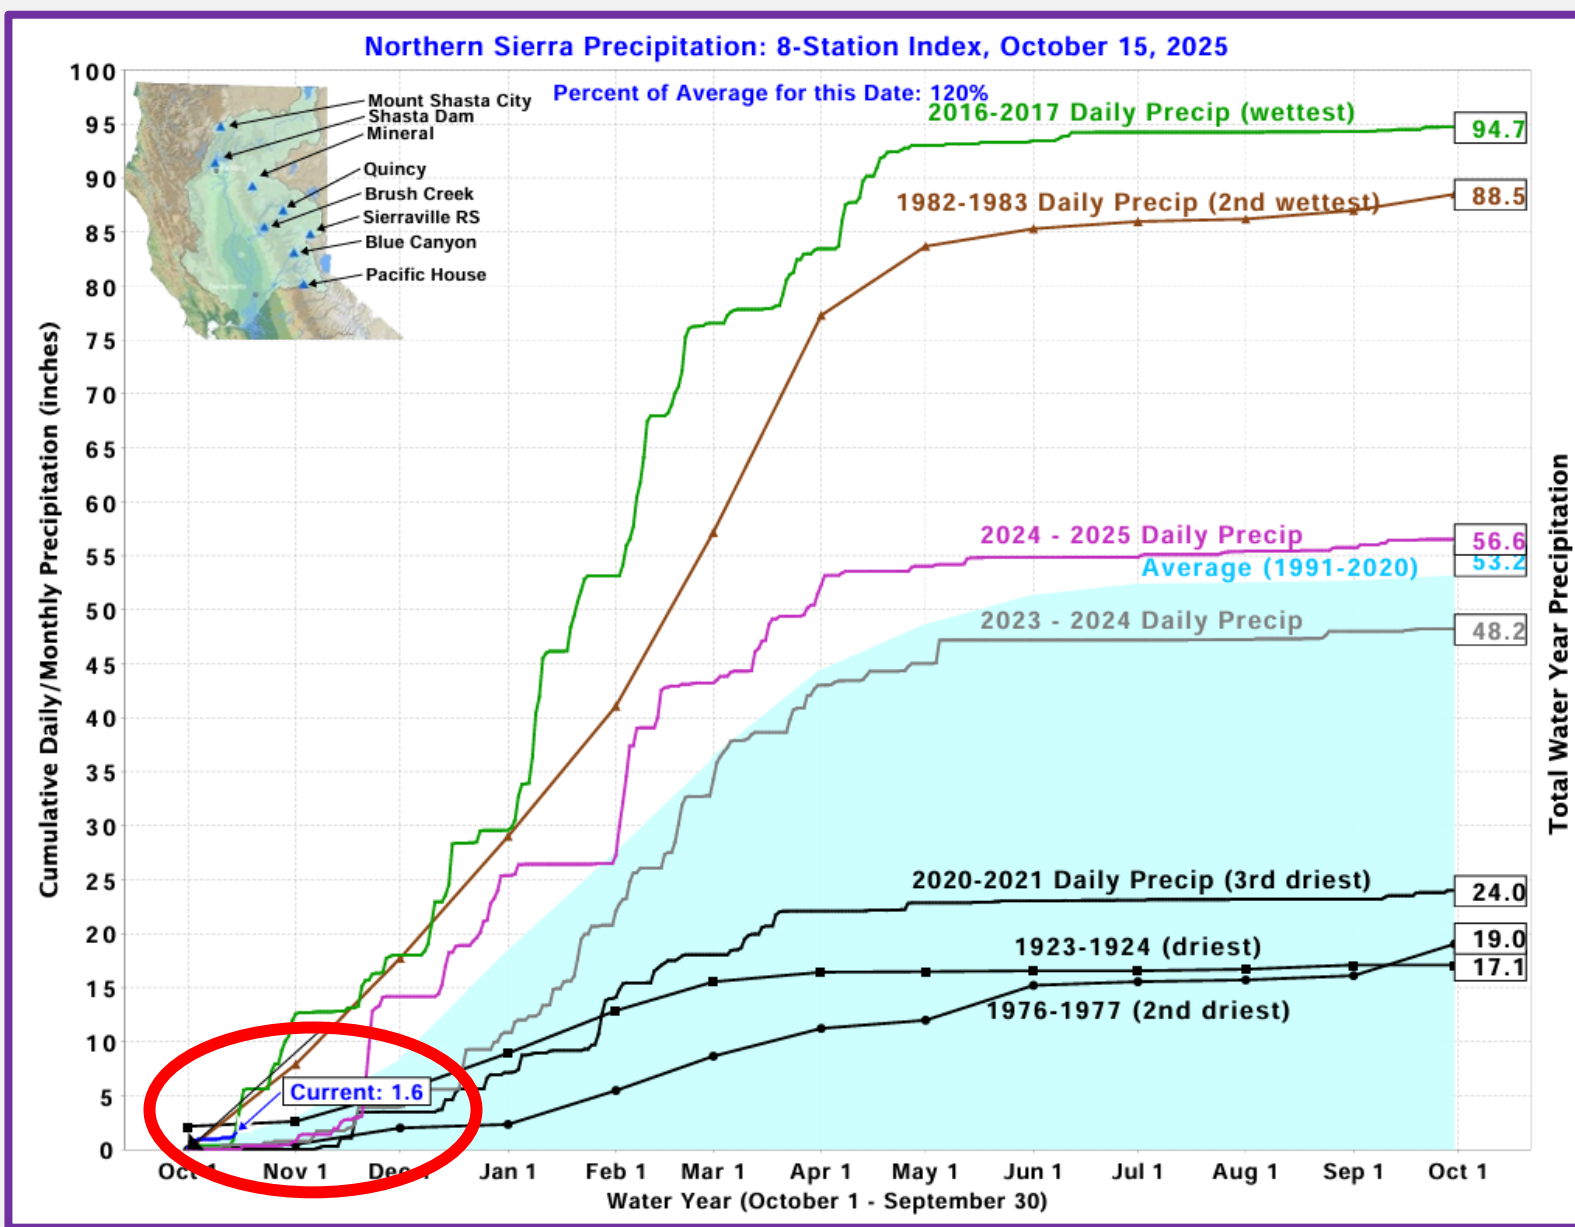


Precipitation Stations – North Sierra




CURRENT CONDITIONS: MAJOR WATER SUPPLY RESERVOIRS:14-OCT-2025

Data as of Midnight: 14-Oct-2025

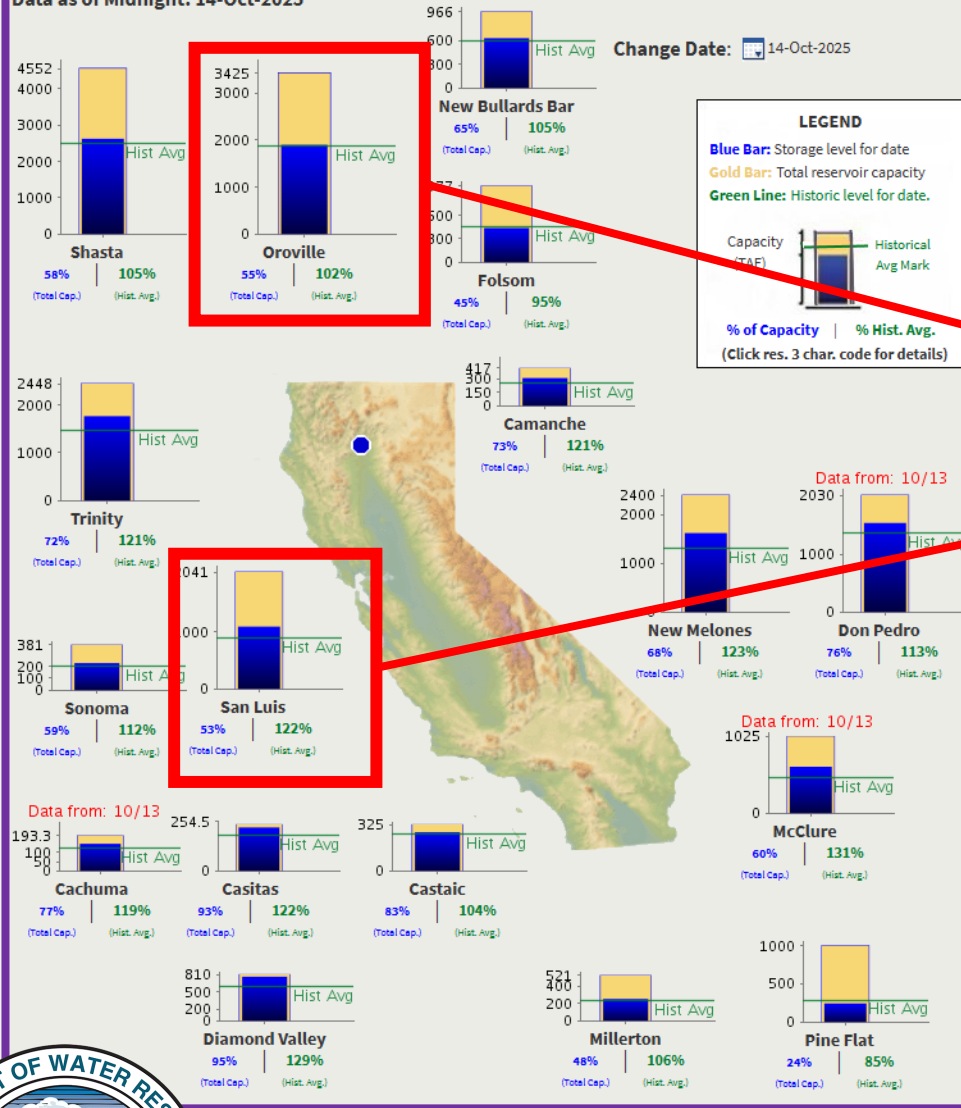

San Luis Res Levels: Various Past Water Years and Current Water Year, Ending At Midnight October 14, 2025

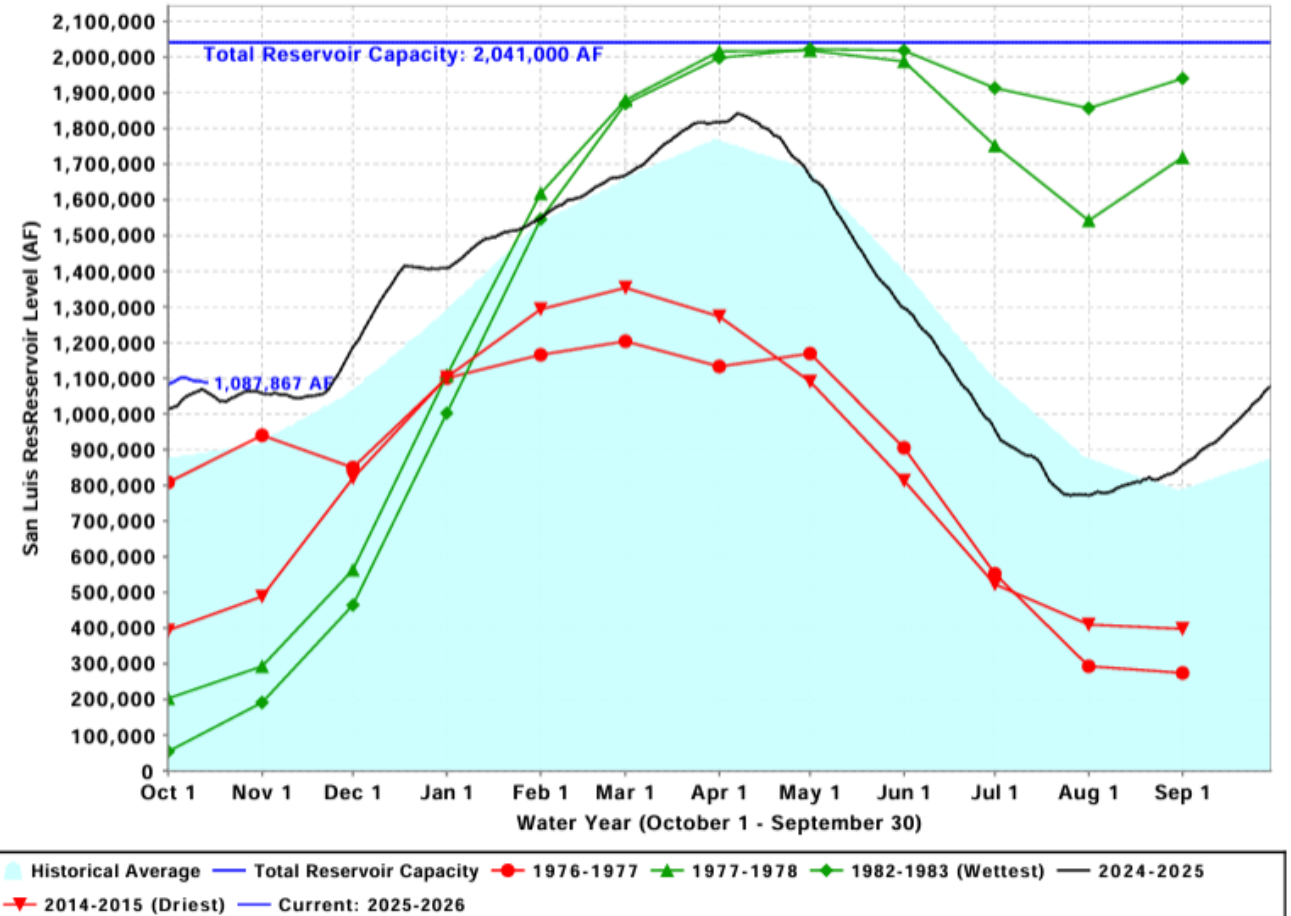

Current Reservoir Conditions



SWP Allocation Timeline

December 2, 2024: 5% Allocation

December 23, 2024: 15% Allocation

January 28, 2025: 20% Allocation

February 25, 2025: 35% Allocation


March 25, 2025: 40% Allocation

April 29, 2025: 50% Allocation

SGPWA Portfolio @ 50%

Source	Total (AF)	Delivered
SWP – Carryover	1,217	✓
SWP – Table A	8,650	✓
SWP – Ventura	5,000	✓
Non-SWP - Nickel Water	1,700	✓
City of Yuba City Purchase	3,000	✓
Total Available Supply	19,567	

Historic SWP Allocations

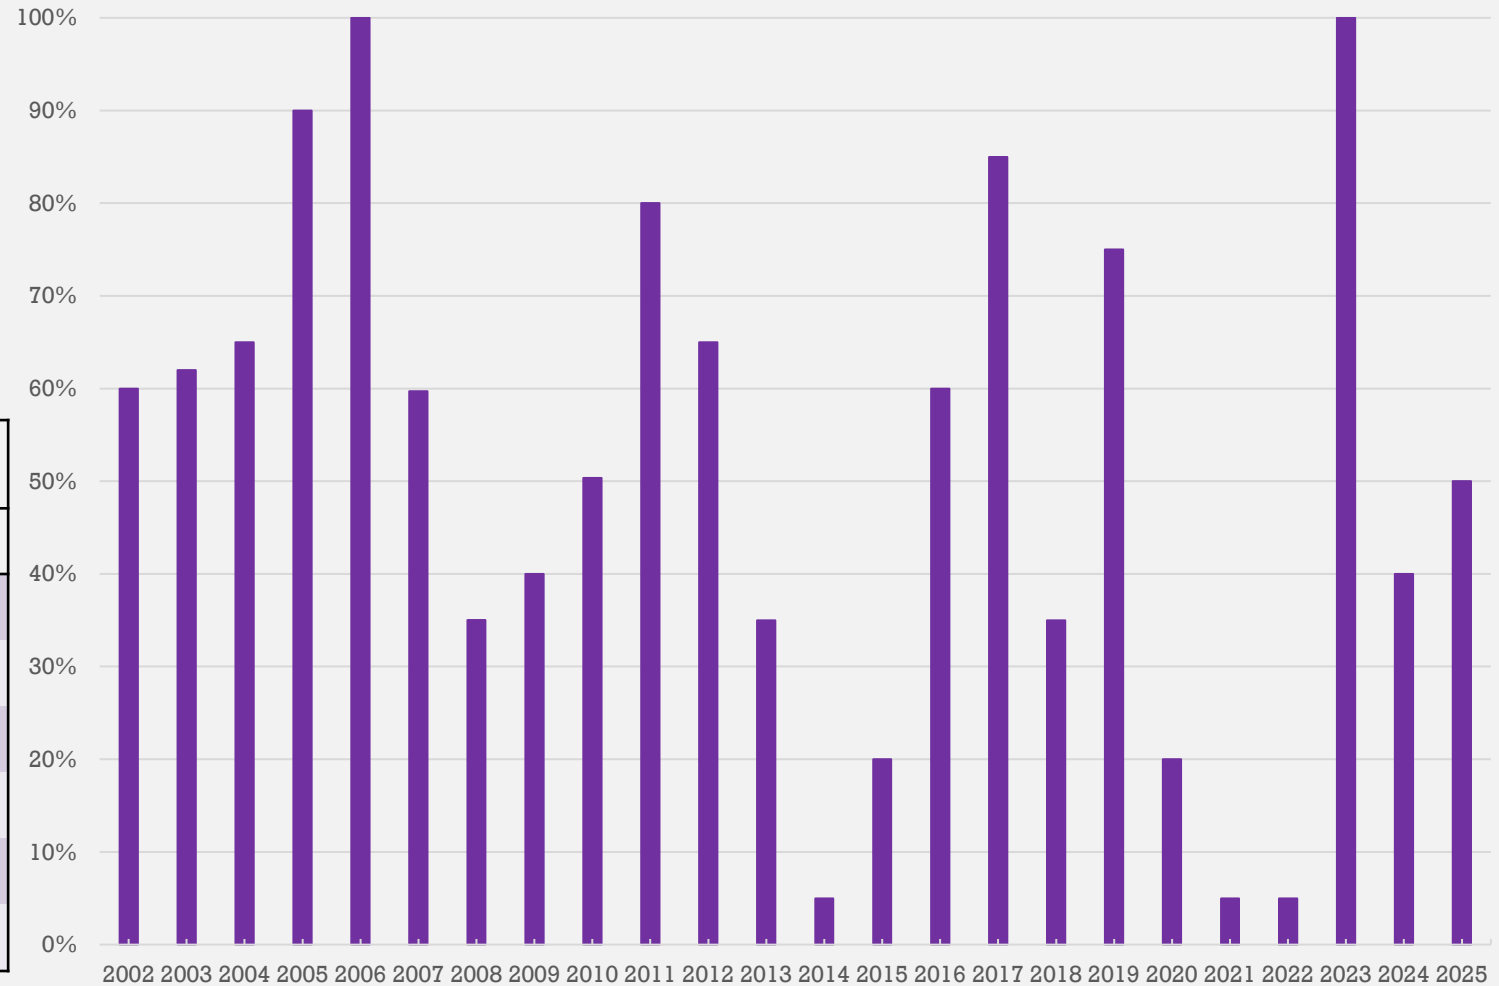

2025 SWP Allocation & Portfolio Update

Water Orders 2025

Total Current Water Orders: 18,150 AF



BCVWD

- 16,200 AF
 - 11,200 AF (*Demands*) ✓
 - 5,000 AF (*Banking*) ✓



YVWD

- 200 AF
 - 200 AF (*Direct Demand*) ✓



City of Banning

- 1,750 AF
 - 1,500 AF (*Demands*) ✓
 - 250 AF (*Banking*) ✓



SGPWA

- TBD (Future Supply)



Water Orders 2026

Total Future Water Orders: 16,200 AF



BCVWD

- 14,000 AF
 - 11,200 AF (*Demands*)
 - 2,800 AF (*Banking*)



YVWD

- 200 AF
 - 200 AF (*Direct Demand*)



City of Banning

- 2,000 AF
 - 1,500 AF (*Demands*)
 - 500 AF (*Banking*)




SGPWA

- TBD (Future Supply)



Water Orders 2025 & 2026

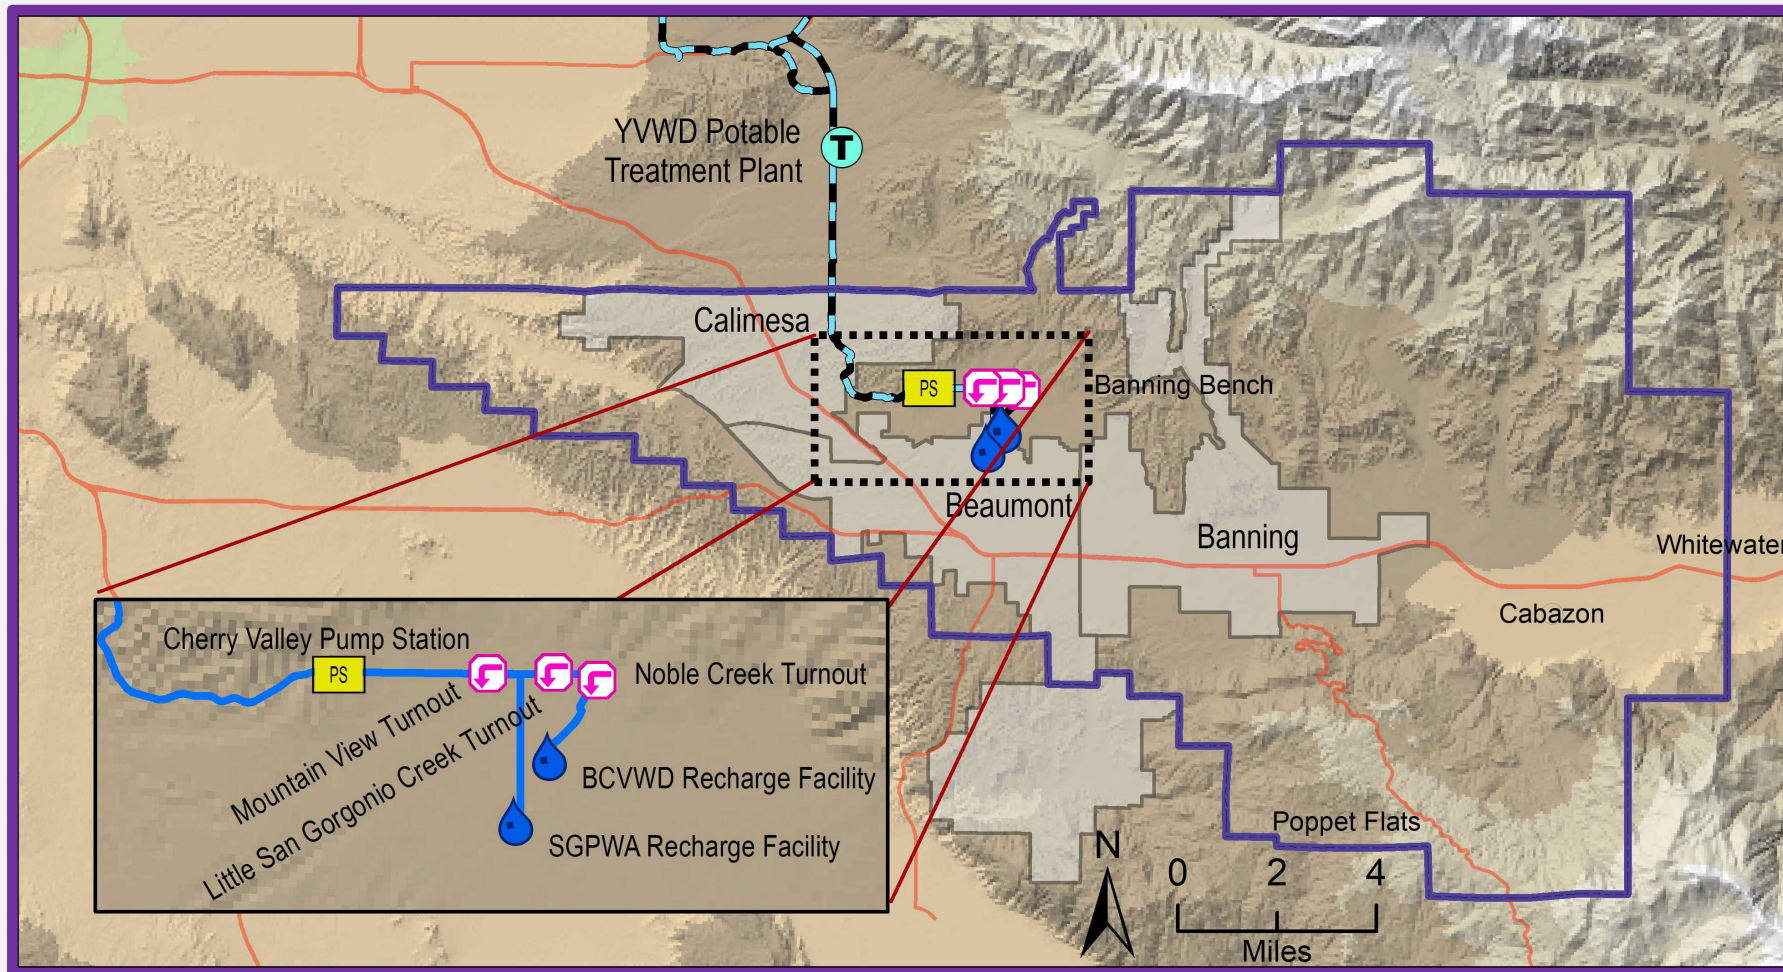

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sept	Oct	Nov	Dec	Total
Recharge	53	1,034	2,306	1,973	1,515	2,052	1,789	2,132	2,458	2,100			17,412
Direct	0	0	13	0	0	0	0	0	0	0			13

**Estimated*

**From Local Storage*




Local Deliveries 2025 (acre-feet)

Subject to Final Verification



2023-25 SGPWA SWP Deliveries

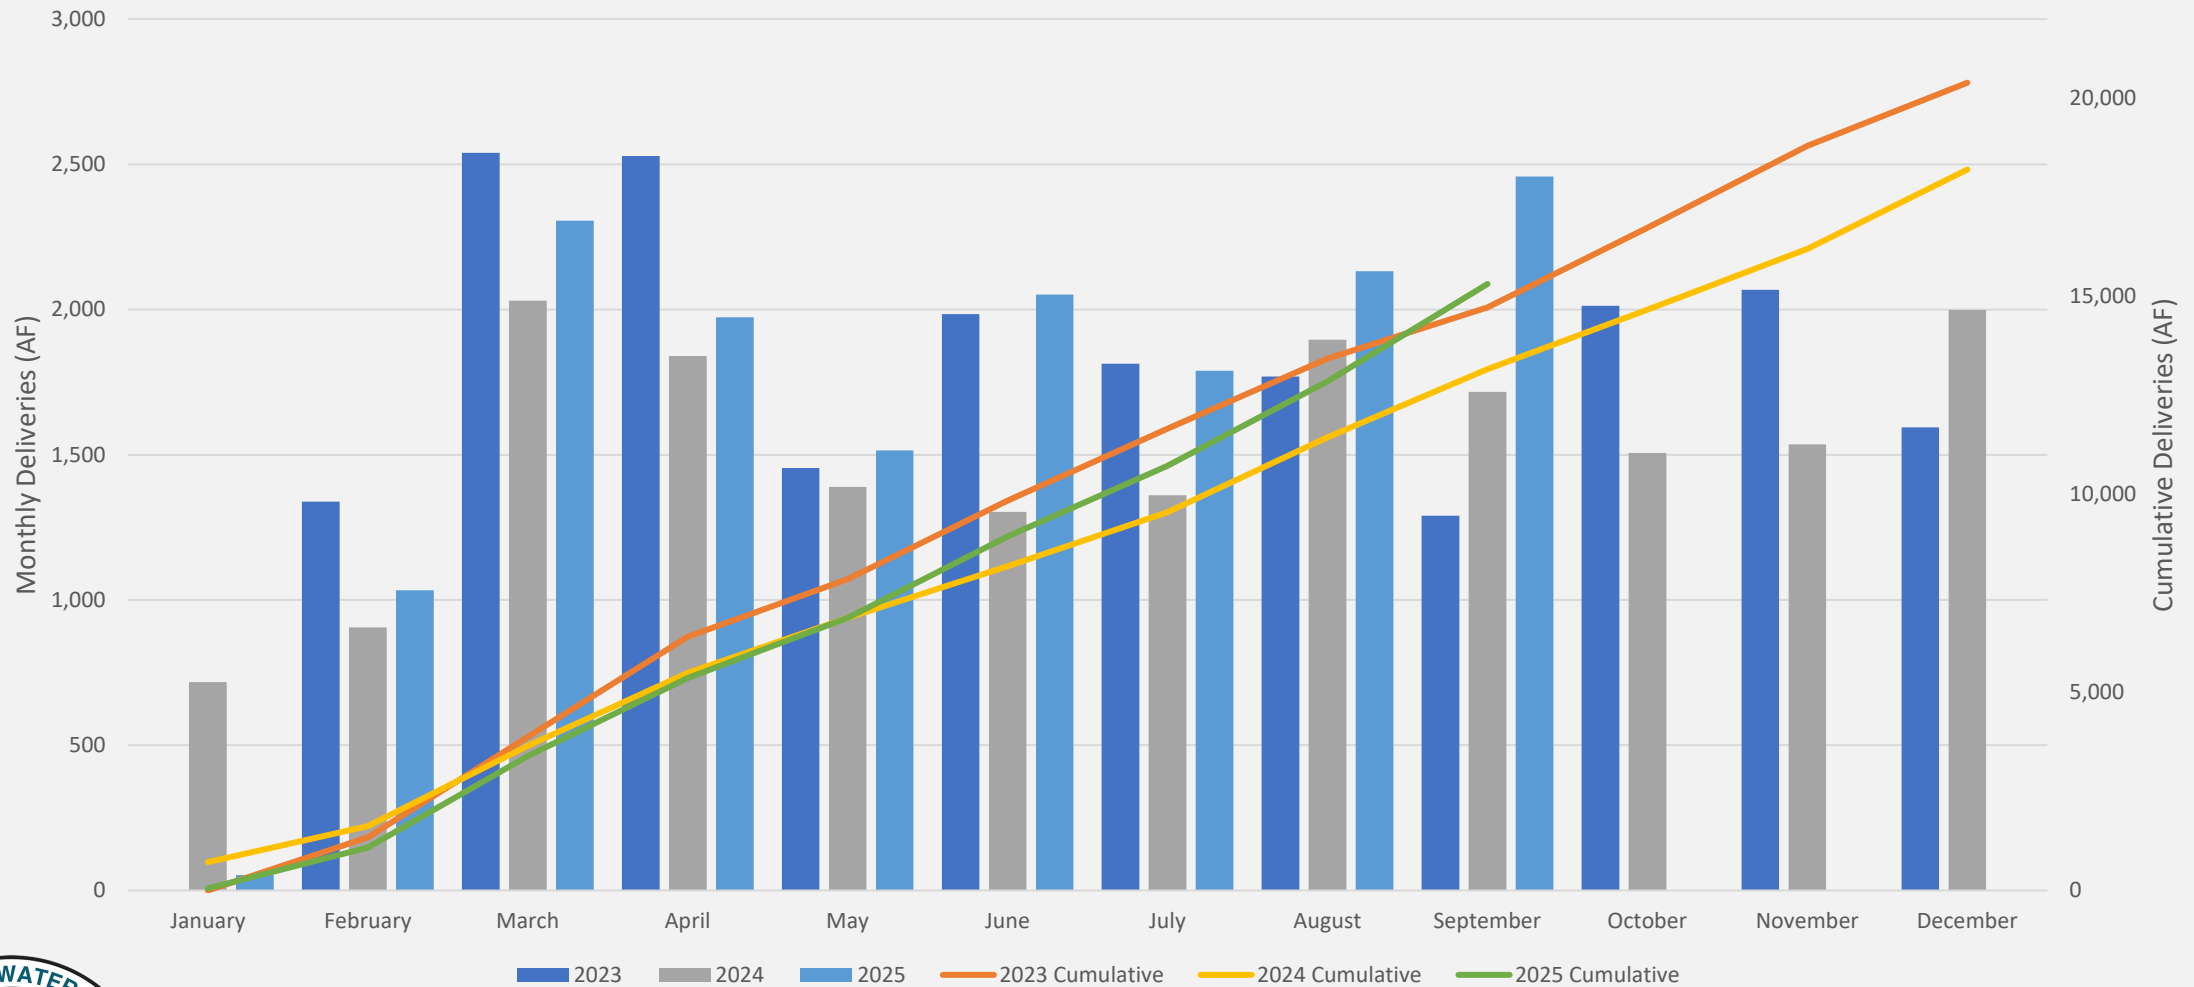

Annual Comparison of SWP Deliveries





Brookside East Recharge Facility



BCVWD Recharge Facilities



October Recharge Photos

