

Water Conditions Report

Board of Directors Meeting

March 16, 2026






Northern Sierra 8-Station

Precipitation Index for Water Year 2026 - Updated on March 12, 2026 10:35 AM



Note: Monthly totals may not add up to seasonal total because of rounding

Water Year Monthly totals are calculated based on Daily precipitation data from 12am to 12am PST

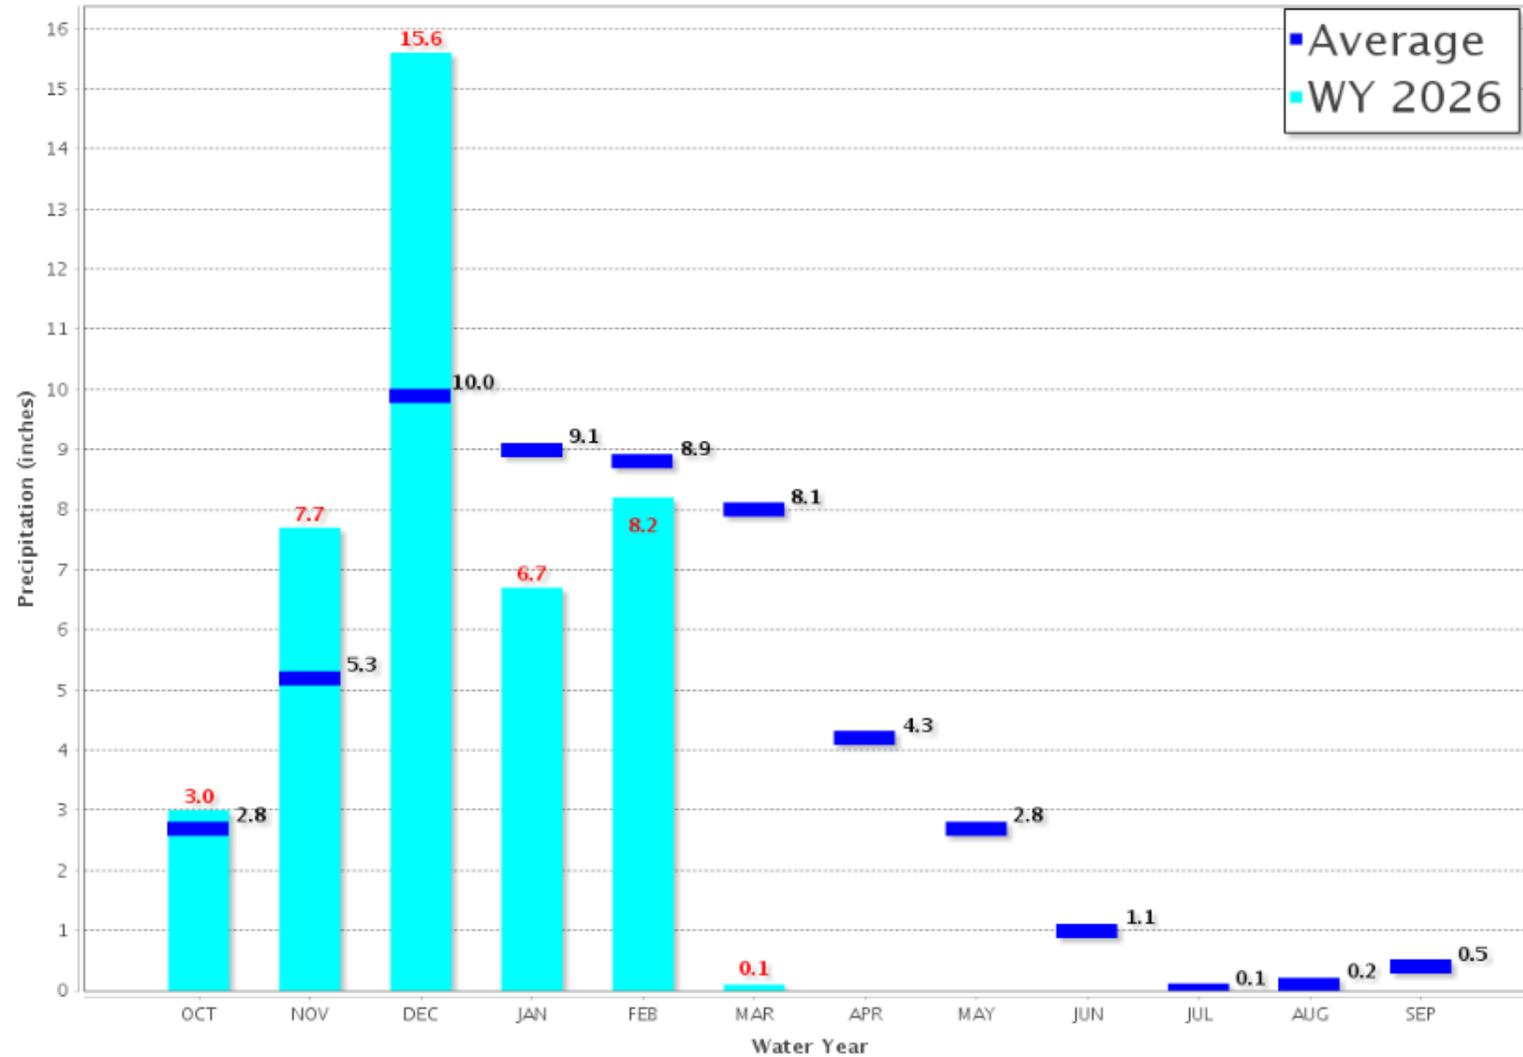

State Precipitation Stations – North Sierra



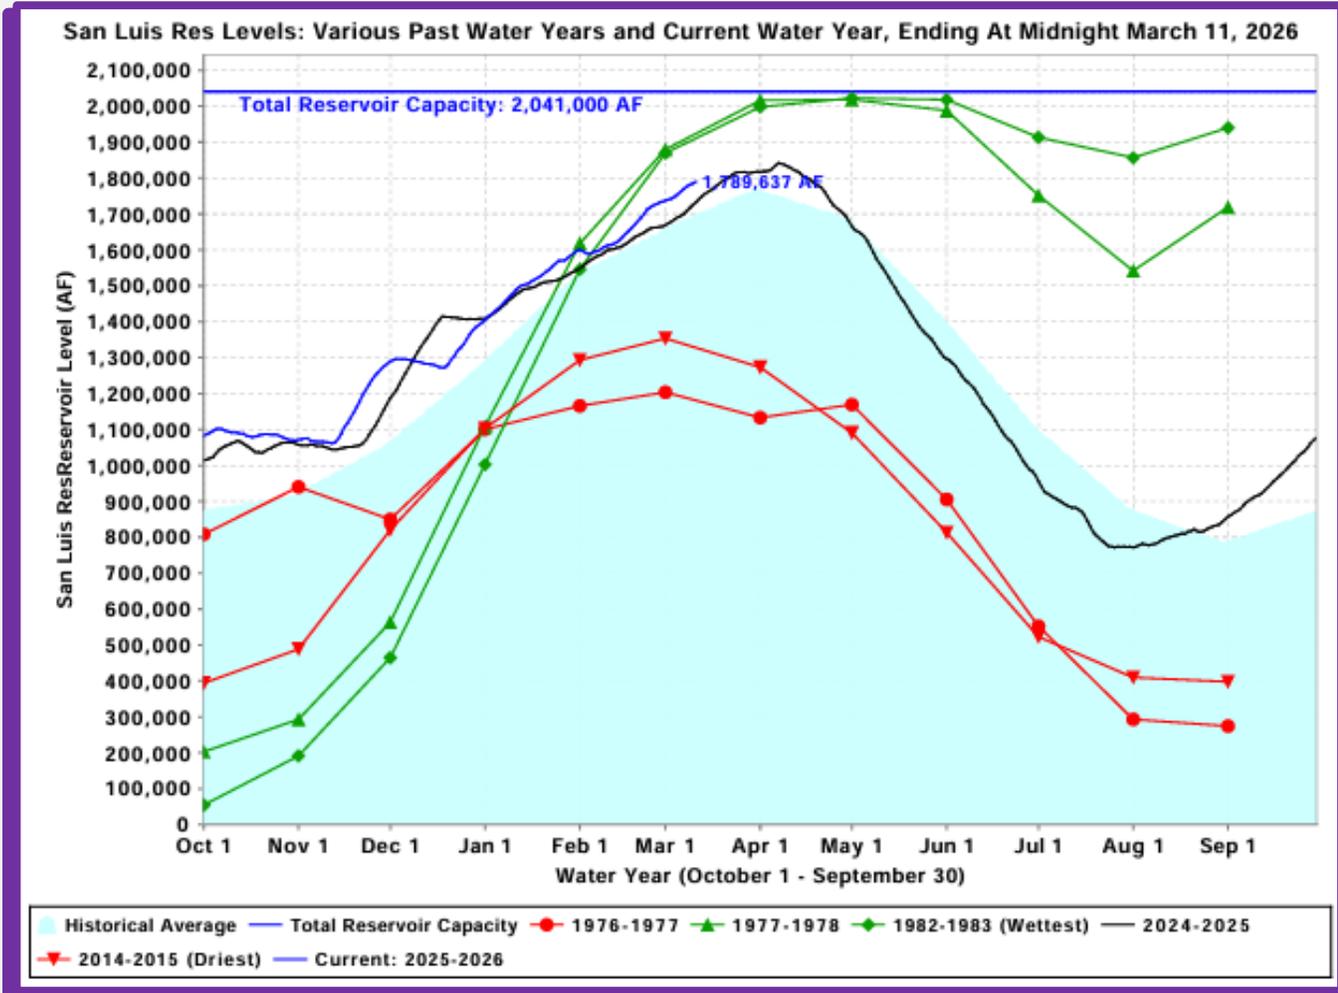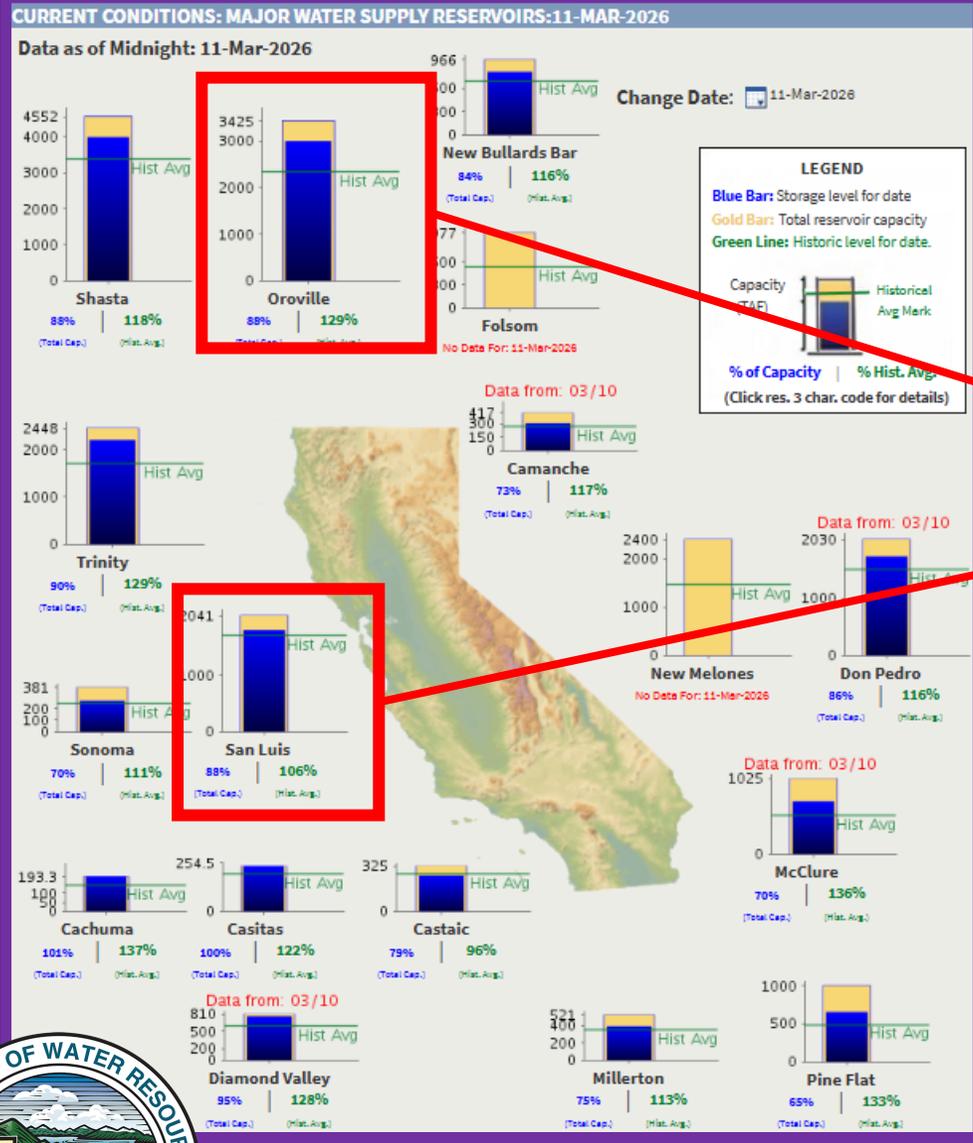


Current Reservoir Conditions

6-Day Forecast Precipitation

River Forecast Center
Sacramento, CA



Thu Mar 12, 2026 5 AM PDT to Wed Mar 18, 2026 5 AM PDT Issued Mar 12, 2026 6:08 AM PDT

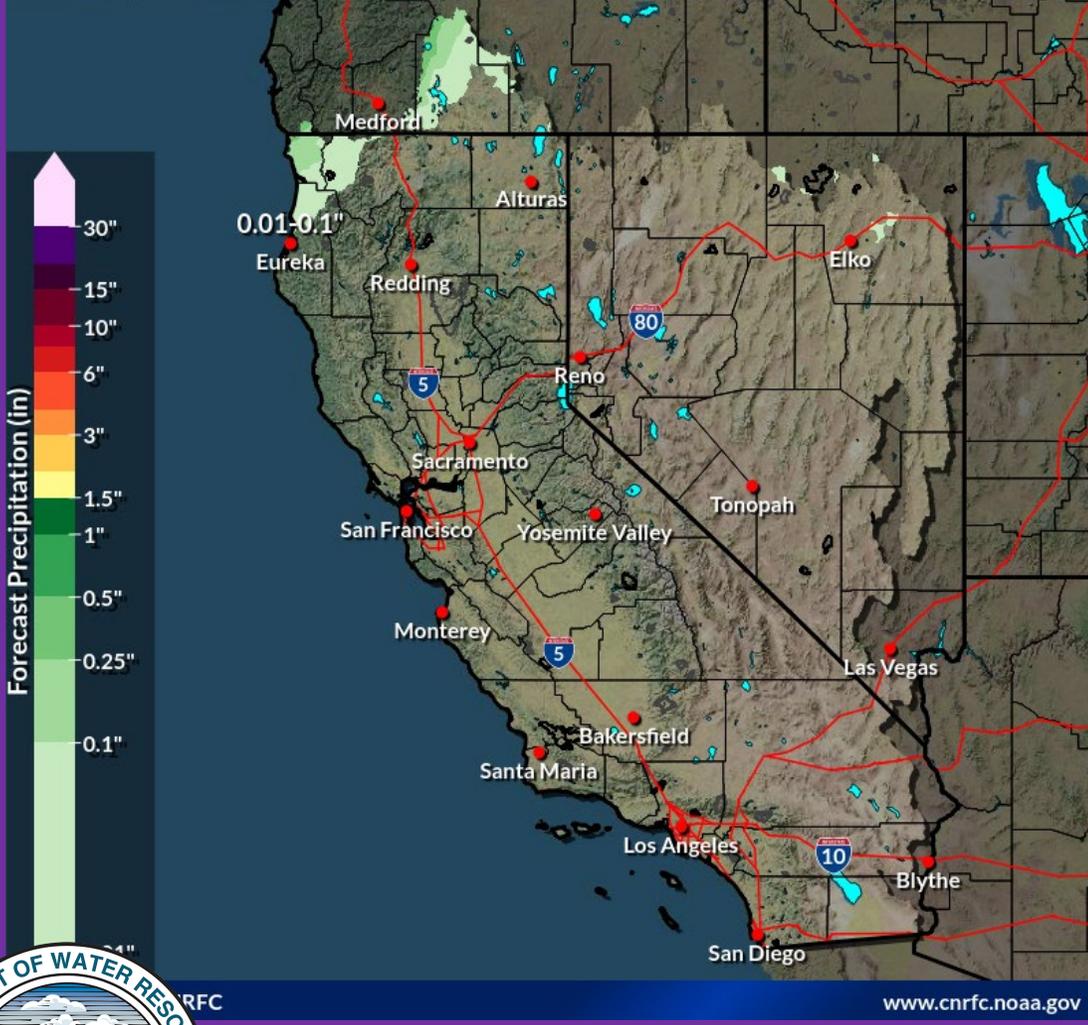


6-Day Forecast Precipitation

River Forecast Center
Sacramento, CA



Thu Mar 12, 2026 5 AM PDT to Wed Mar 18, 2026 5 AM PDT Issued Mar 12, 2026 6:09 AM PDT

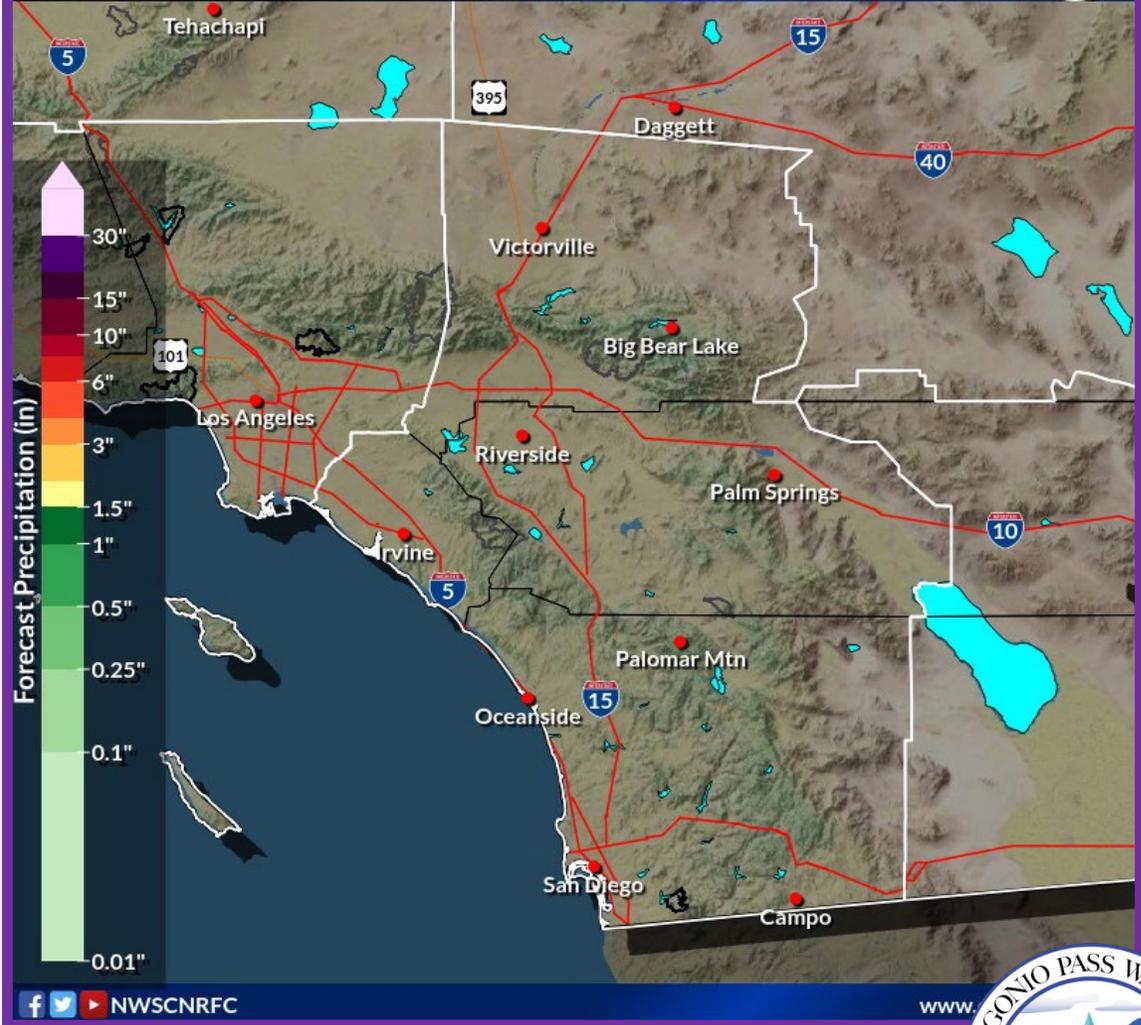

Forecasted Hydrologic Conditions

File Footage: March 1, 2025



CURRENT REGIONAL SNOWPACK FROM AUTOMATED SNOW SENSORS

% of April 1 Average / % of Normal for This Date



NORTH	
Data as of March 12, 2026	
Number of Stations Reporting	33
Average snow water equivalent (Inches)	7.6
Percent of April 1 Average (%)	28
Percent of normal for this date (%)	29

CENTRAL	
Data as of March 12, 2026	
Number of Stations Reporting	51
Average snow water equivalent (Inches)	14.1
Percent of April 1 Average (%)	50
Percent of normal for this date (%)	53

SOUTH	
Data as of March 12, 2026	
Number of Stations Reporting	26
Average snow water equivalent (Inches)	16.9
Percent of April 1 Average (%)	69
Percent of normal for this date (%)	72

STATE	
Data as of March 12, 2026	
Number of Stations Reporting	110
Average snow water equivalent (Inches)	12.8
Percent of April 1 Average (%)	48
Percent of normal for this date (%)	50

Statewide Average: 48% / 50%



Snowpack Report

SWP Allocation Timeline

2026 Table A Allocation Timeline

December 1, 2025: 10% allocation

January 29, 2026: 30% allocation


SGPWA Portfolio @ 30%

Source	Total (AF)	Delivered
SWP – Carryover	50	✓
SWP – Table A	5,190	✓
SWP – Ventura	3,000	
Non-SWP - Nickel Water	1,700	
County of Napa Transfer	3,000	
Total Available Supply	12,940	

*Note: Does not include:


1. AVEK Return Water = 3,200 AF
2. Beaumont Basin Storage Account = 2,500 AF
3. SBVMWD Return Water = 4,250 AF

Historic SWP Allocations

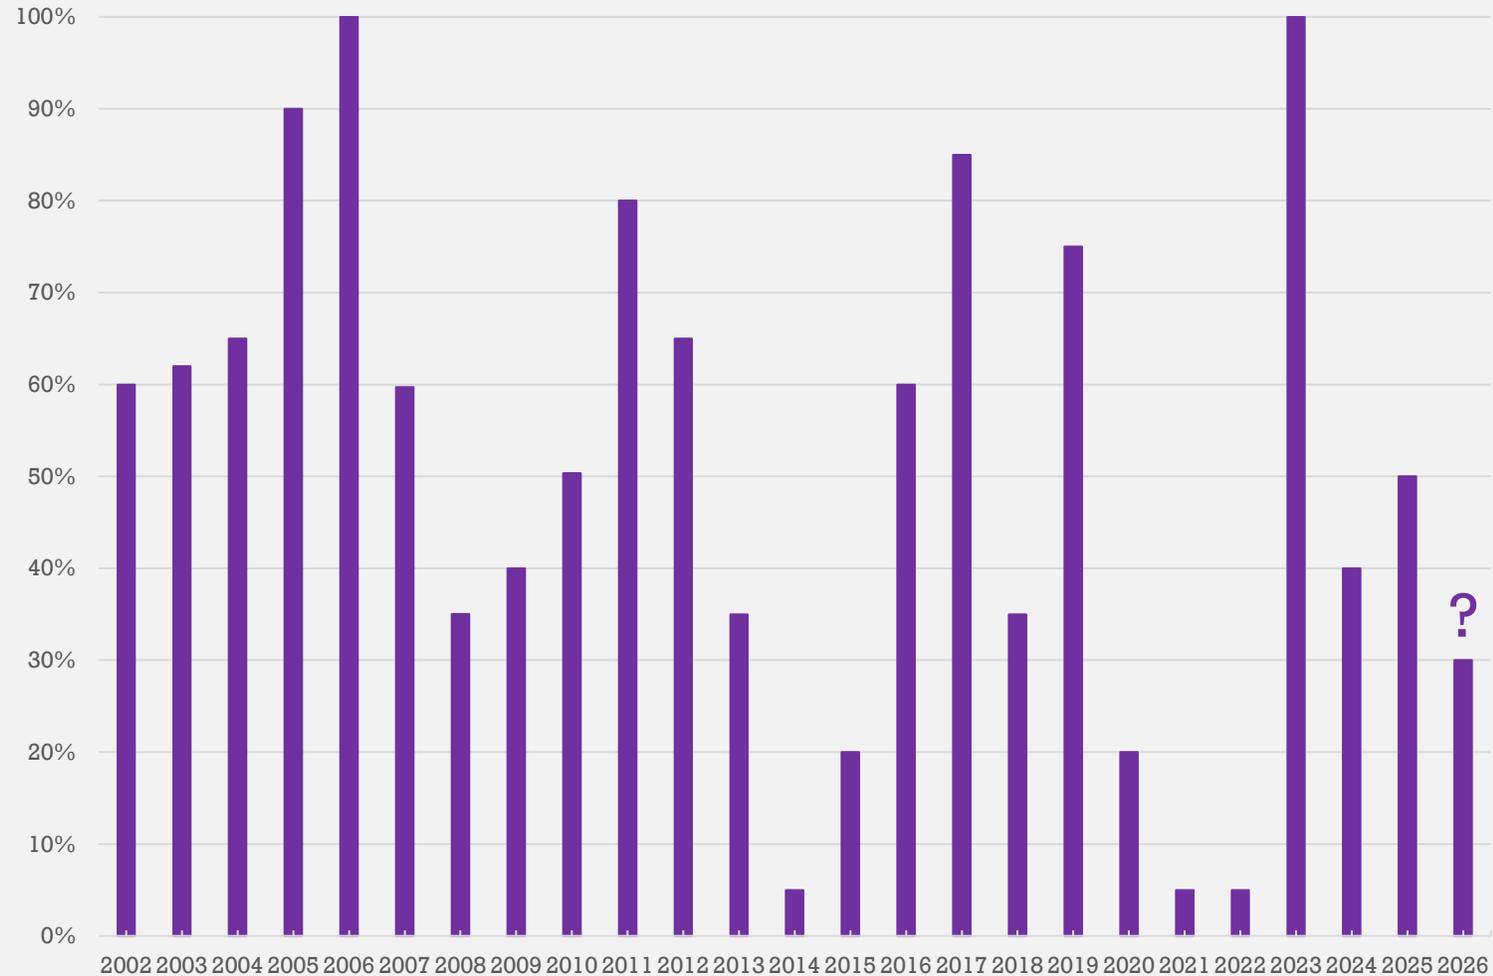

2026 SWP Allocation & Portfolio Update



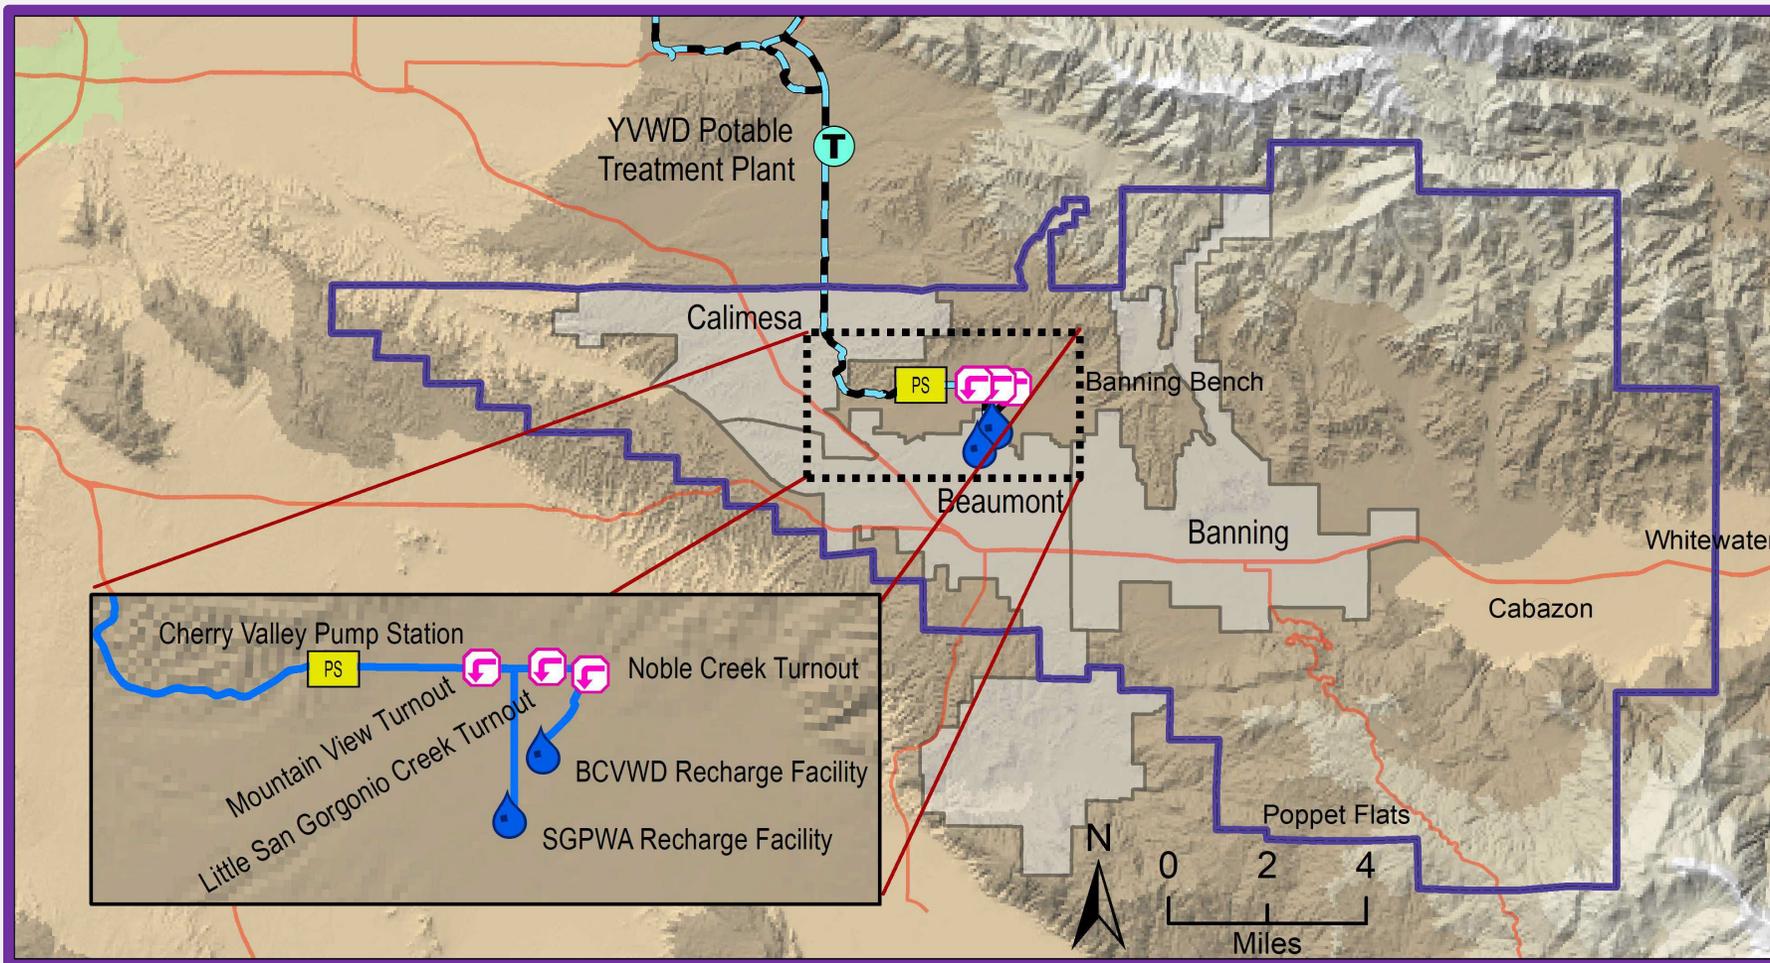

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sept	Oct	Nov	Dec	Total
Recharge	1,327	1,881	2,000	-	-	-	-	-	-	-	-	-	5,208
Direct	0	8	0	-	-	-	-	-	-	-	-	-	8


**Estimated*
**From Local Storage*



Local Deliveries 2026 (acre-feet)

Subject to Final Verification



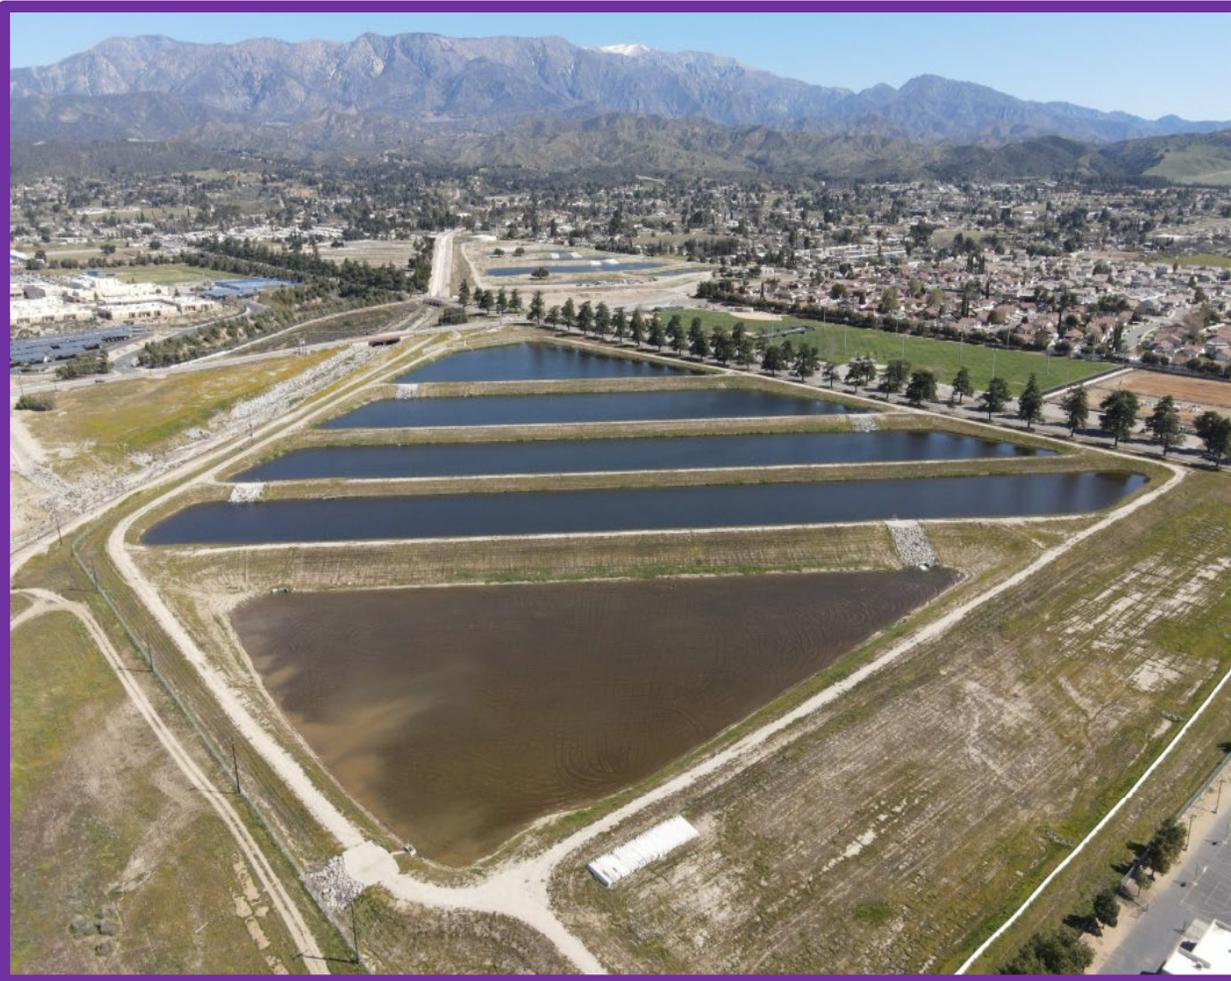

Brookside East Recharge Facility



BCVWD Recharge Facilities



March Recharge Photos