
Water Conditions Report


Board of Directors Meeting


October 19, 2026



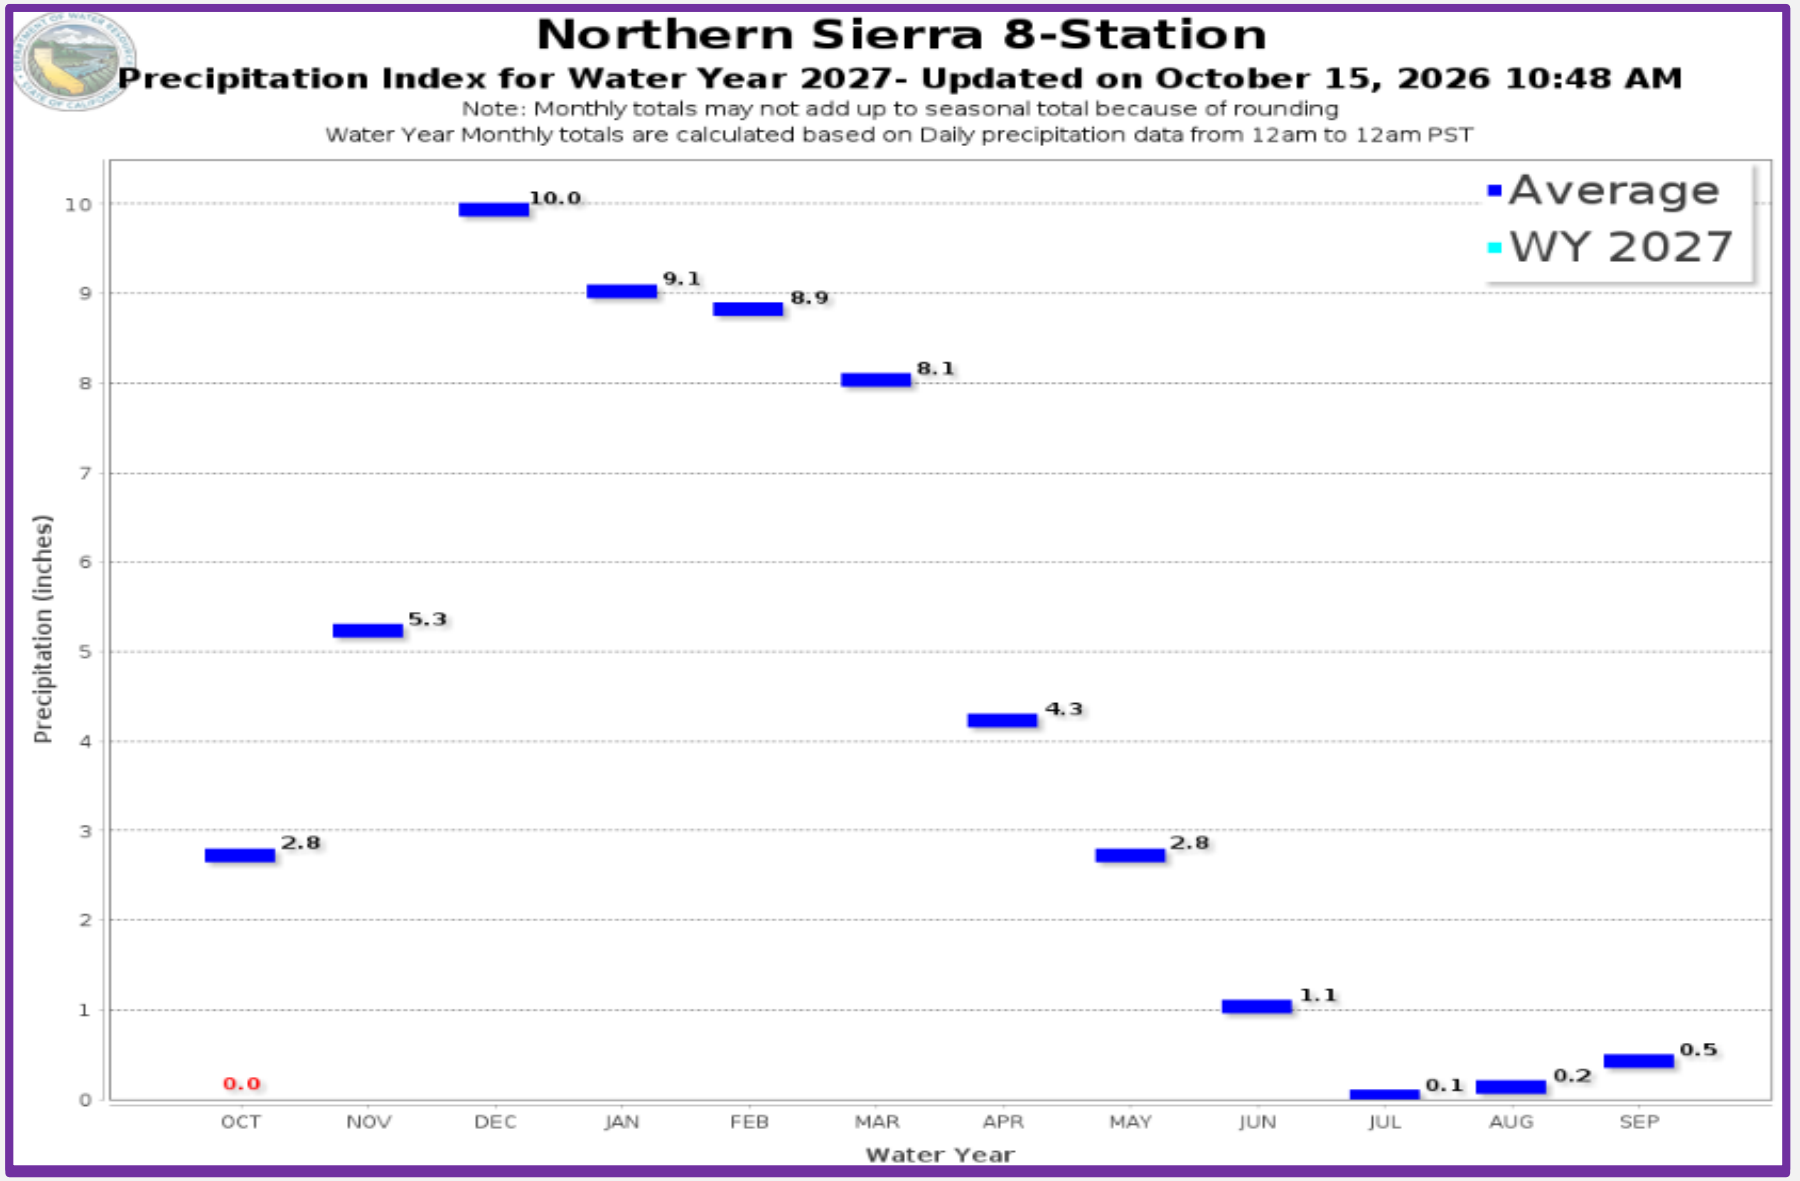

State Precipitation Stations – North Sierra

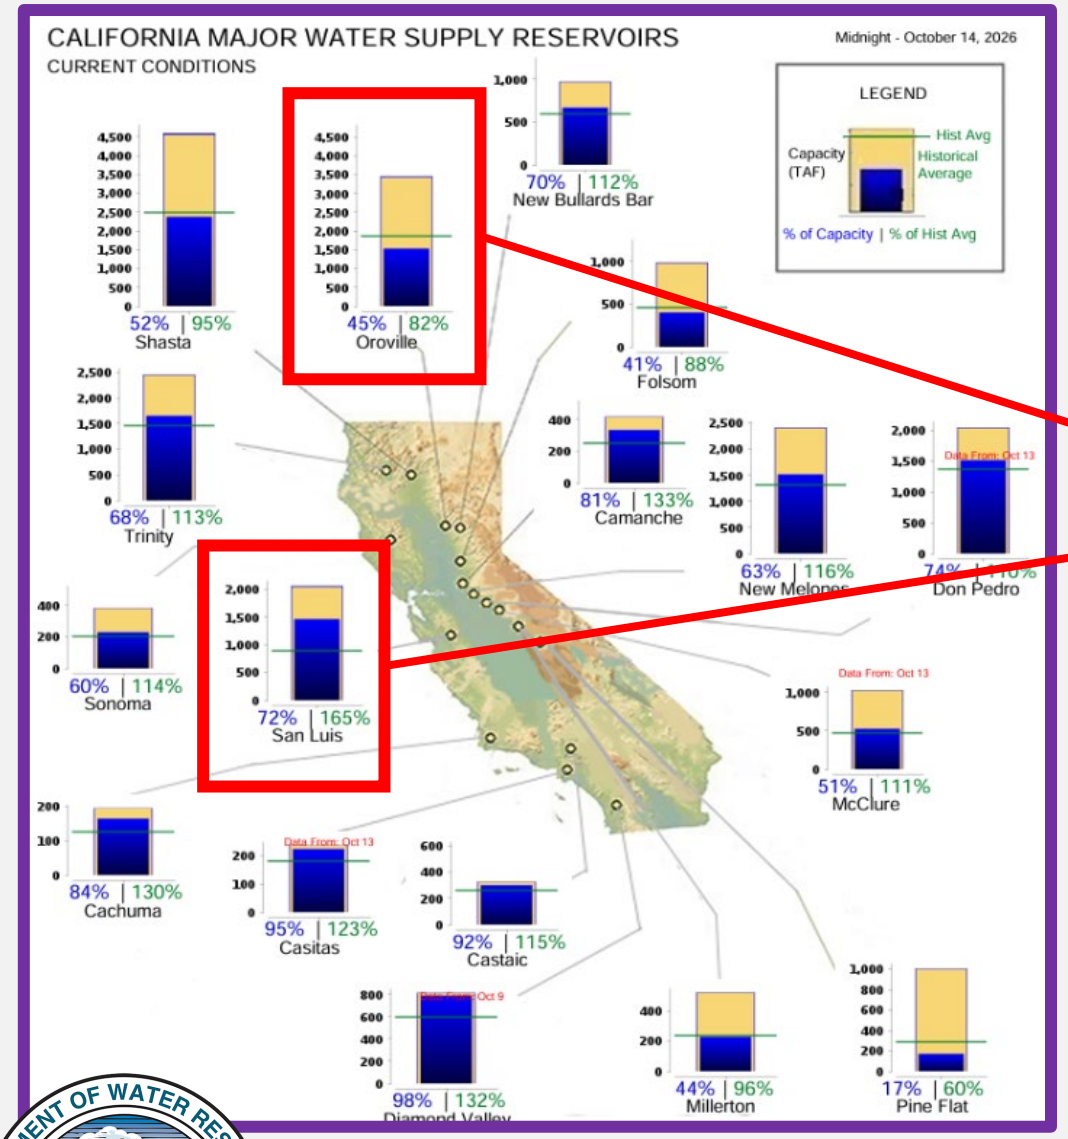

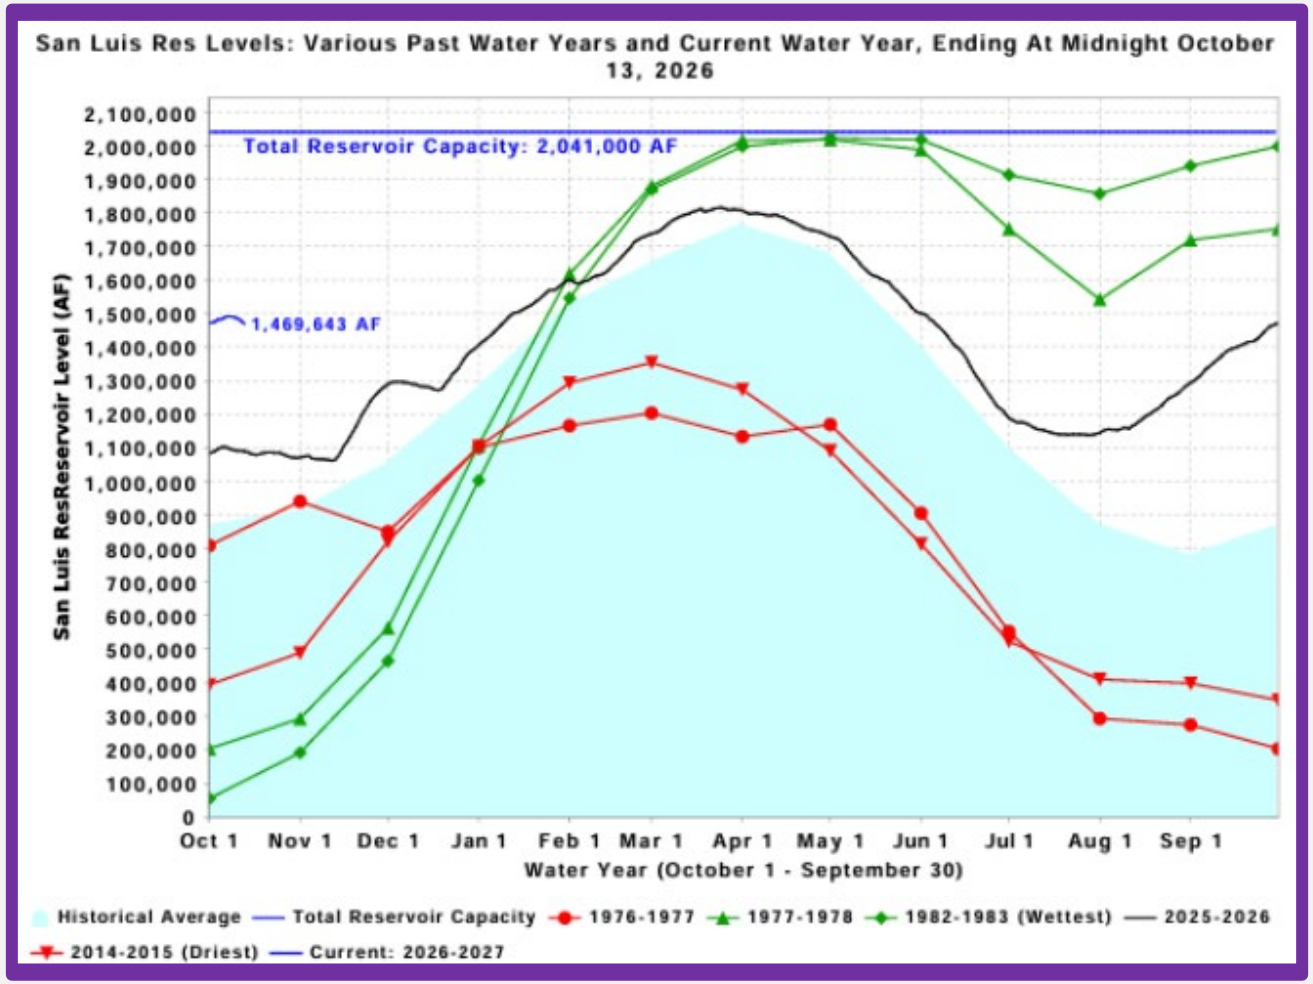


Current Reservoir Conditions


SWP Allocation Timeline

2026 Table A Allocation Timeline
December 1, 2025: 10% allocation
January 29, 2026: 30% allocation
May 14, 2026: 45% allocation

SGPWA Portfolio @ 45%		
Source	**Total (AF)**	**Delivered**
SWP – Carryover	50	✓
SWP – Table A	7,785	✓
SWP – Ventura	4,500	✓
Non-SWP - Nickel Water	1,700	✓
County of Napa Transfer	3,000	✓
Total Available Supply	17,035	

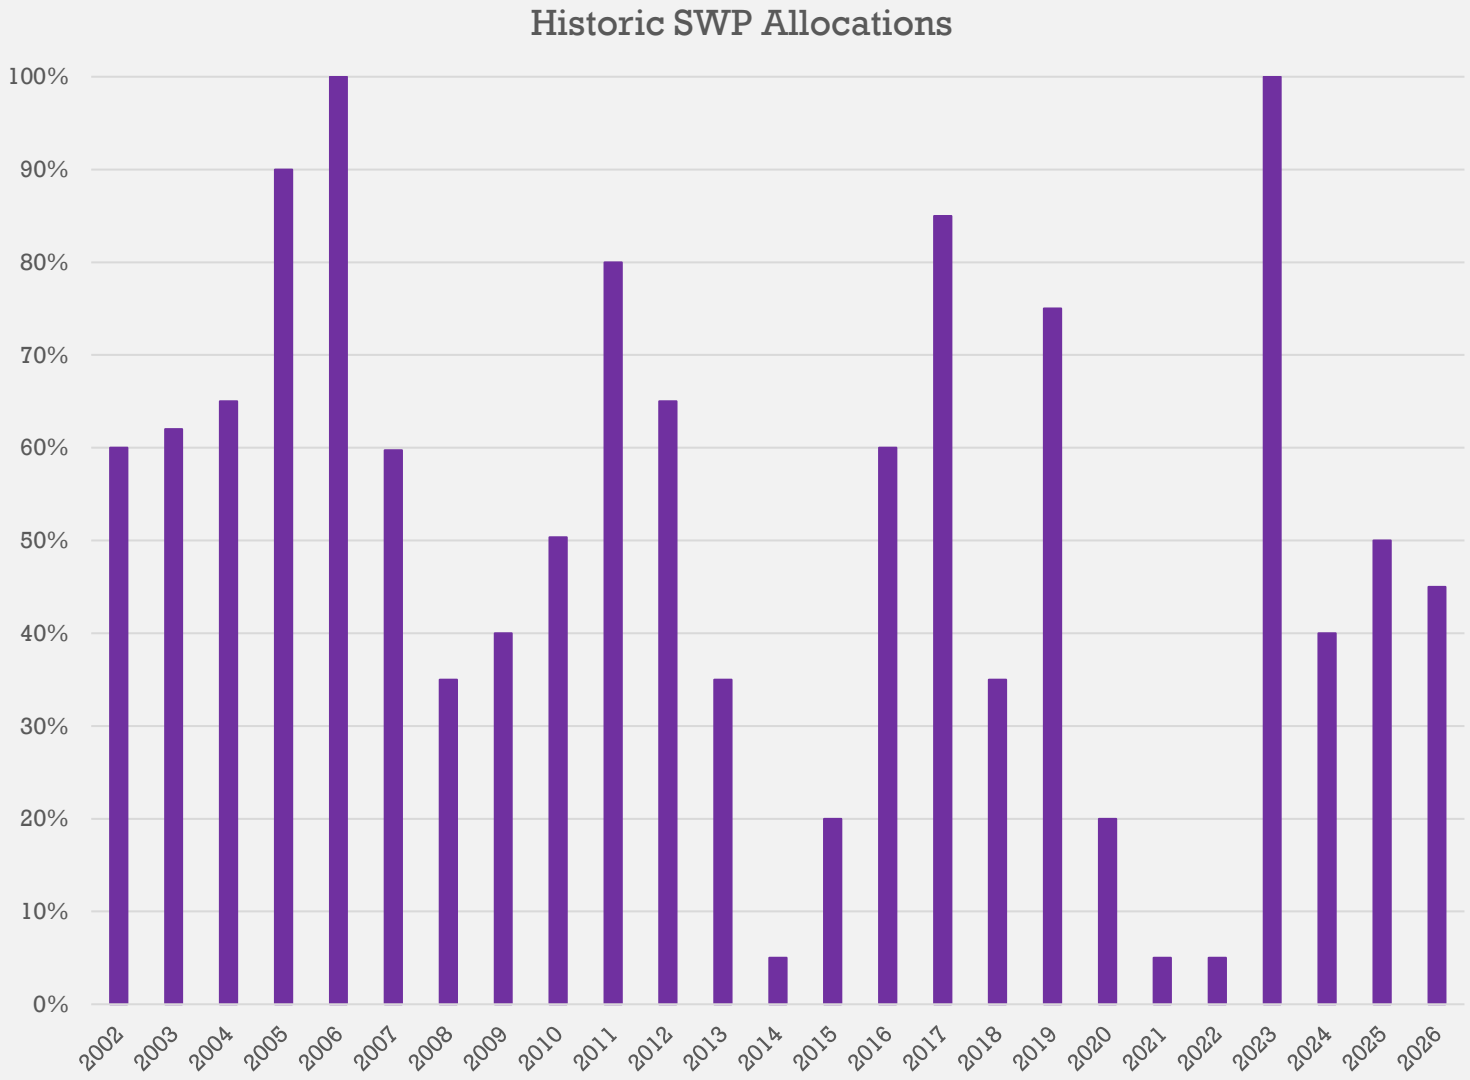

2026 SWP Allocation & Portfolio Update

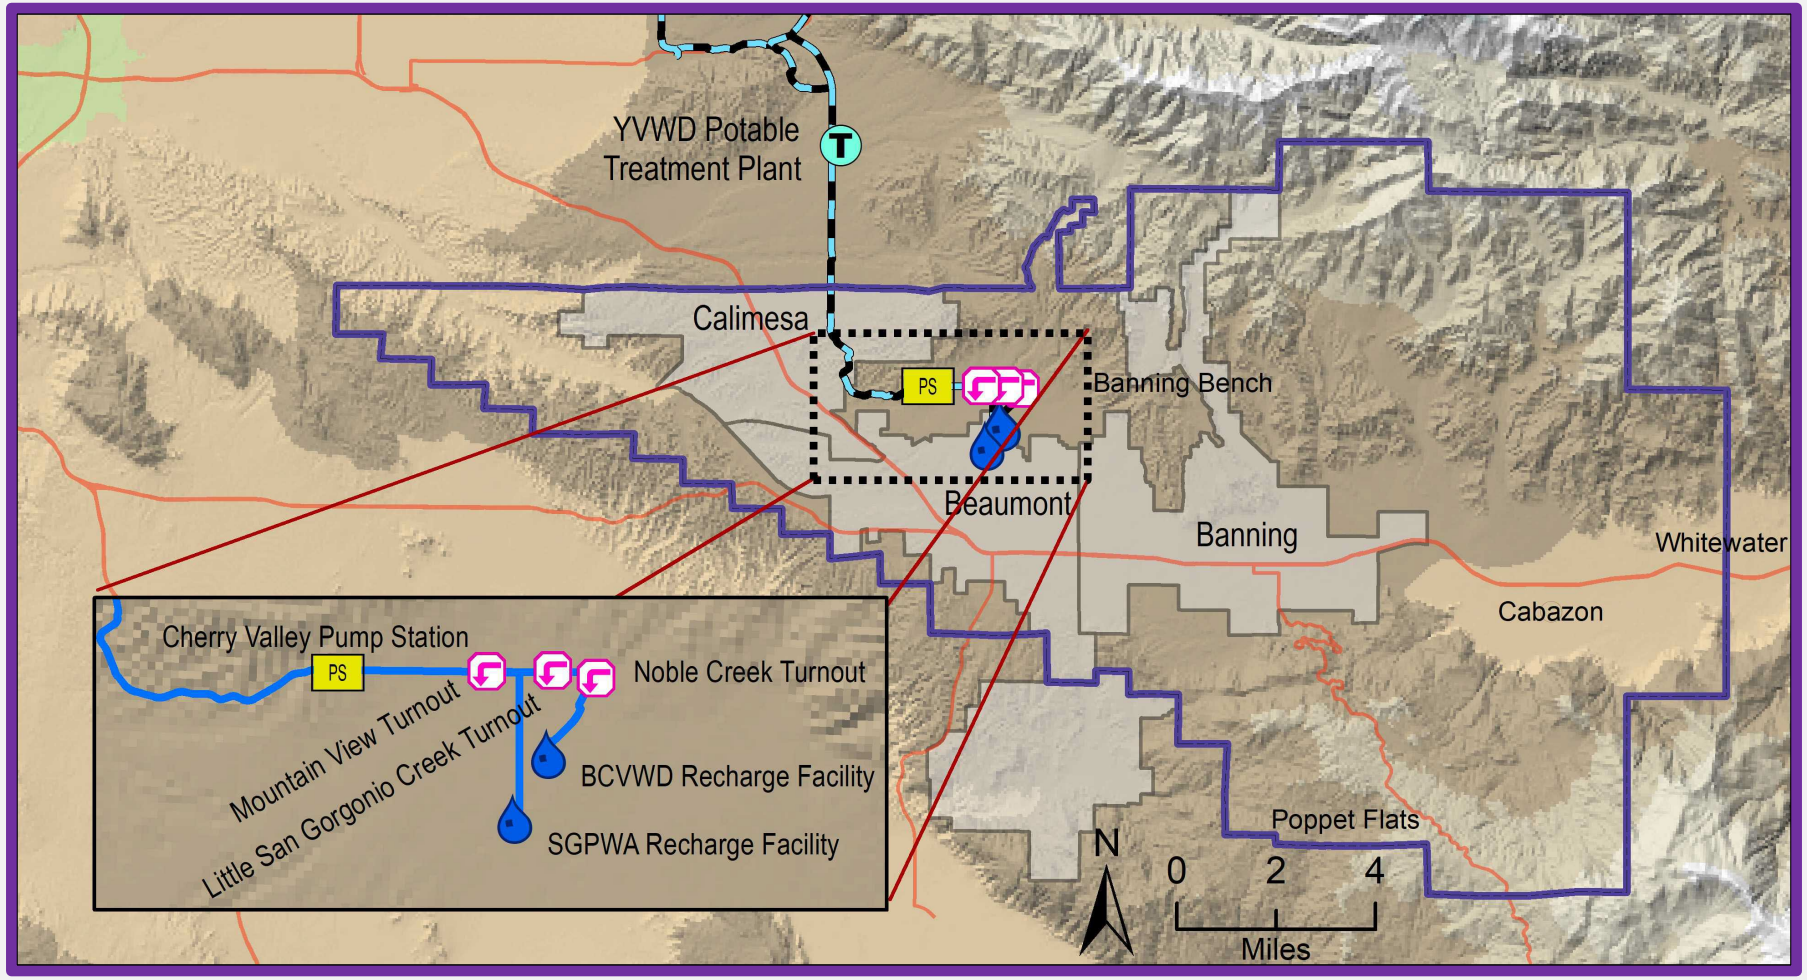

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sept	Oct	Nov	Dec	Total
Recharge	1,327	1,881	2,155	1,143	1,625	2,424	1,745	2,230	1,075	288	-	-	*15,893*
Direct	0	8	51	23	0	0	0	0	0	0	-	-	82

**Estimated*
**From Local Storage*

Local Deliveries 2026 (acre-feet)

Subject to Final Verification



Brookside East Recharge Facility



BCVWD Recharge Facilities

October Recharge Photos